


View of Springfield

PROPERTY FILE

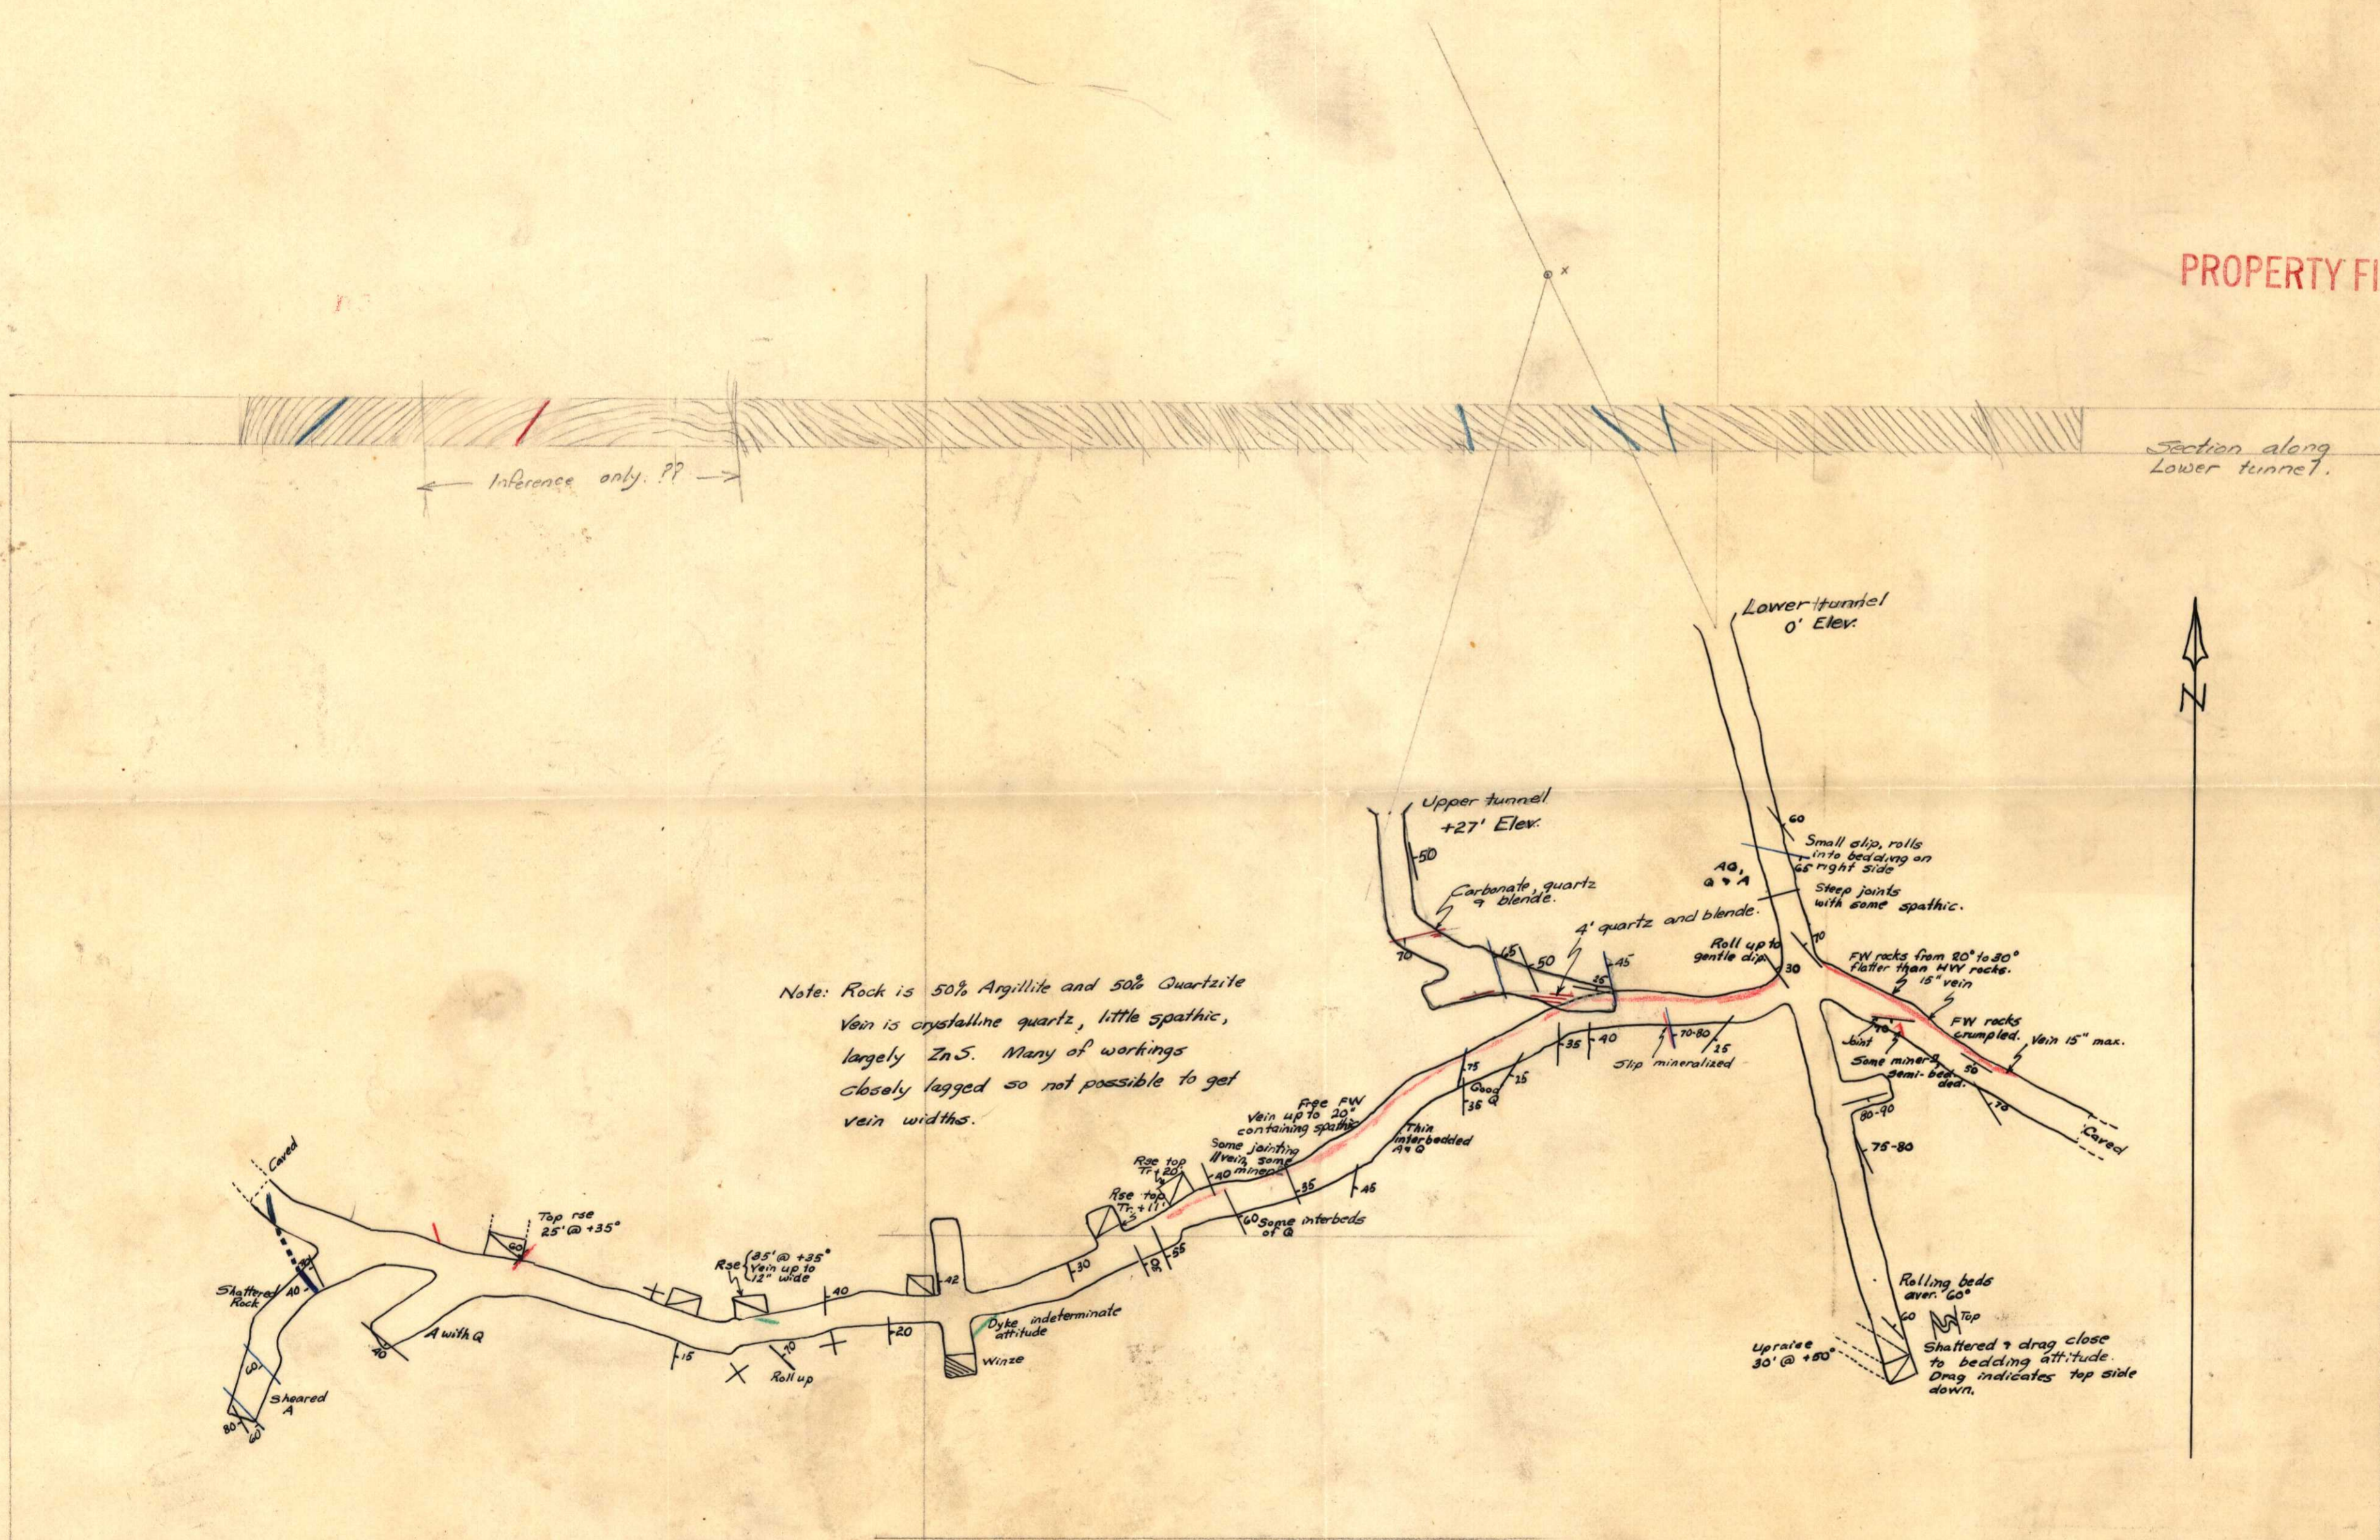

Note: Rock is 50% Argillite and 50% Quartzite  
 Vein is crystalline quartz, little spathic,  
 largely ZnS. Many of workings  
 closely lagged so not possible to get  
 vein widths.


Section along  
 Lower tunnel.



NEW SPRINGFIELD TUNNEL  
 B.C. Dept. of Mines.

July, 1947

Scale 1" = 20'  
 M.S.H. & A.B.I.



82F/14W  
 82F/NW-42  
 199

002461

View of Springfield