

As 61° 00'

10,000


10,000

9900

9900


9800

9800

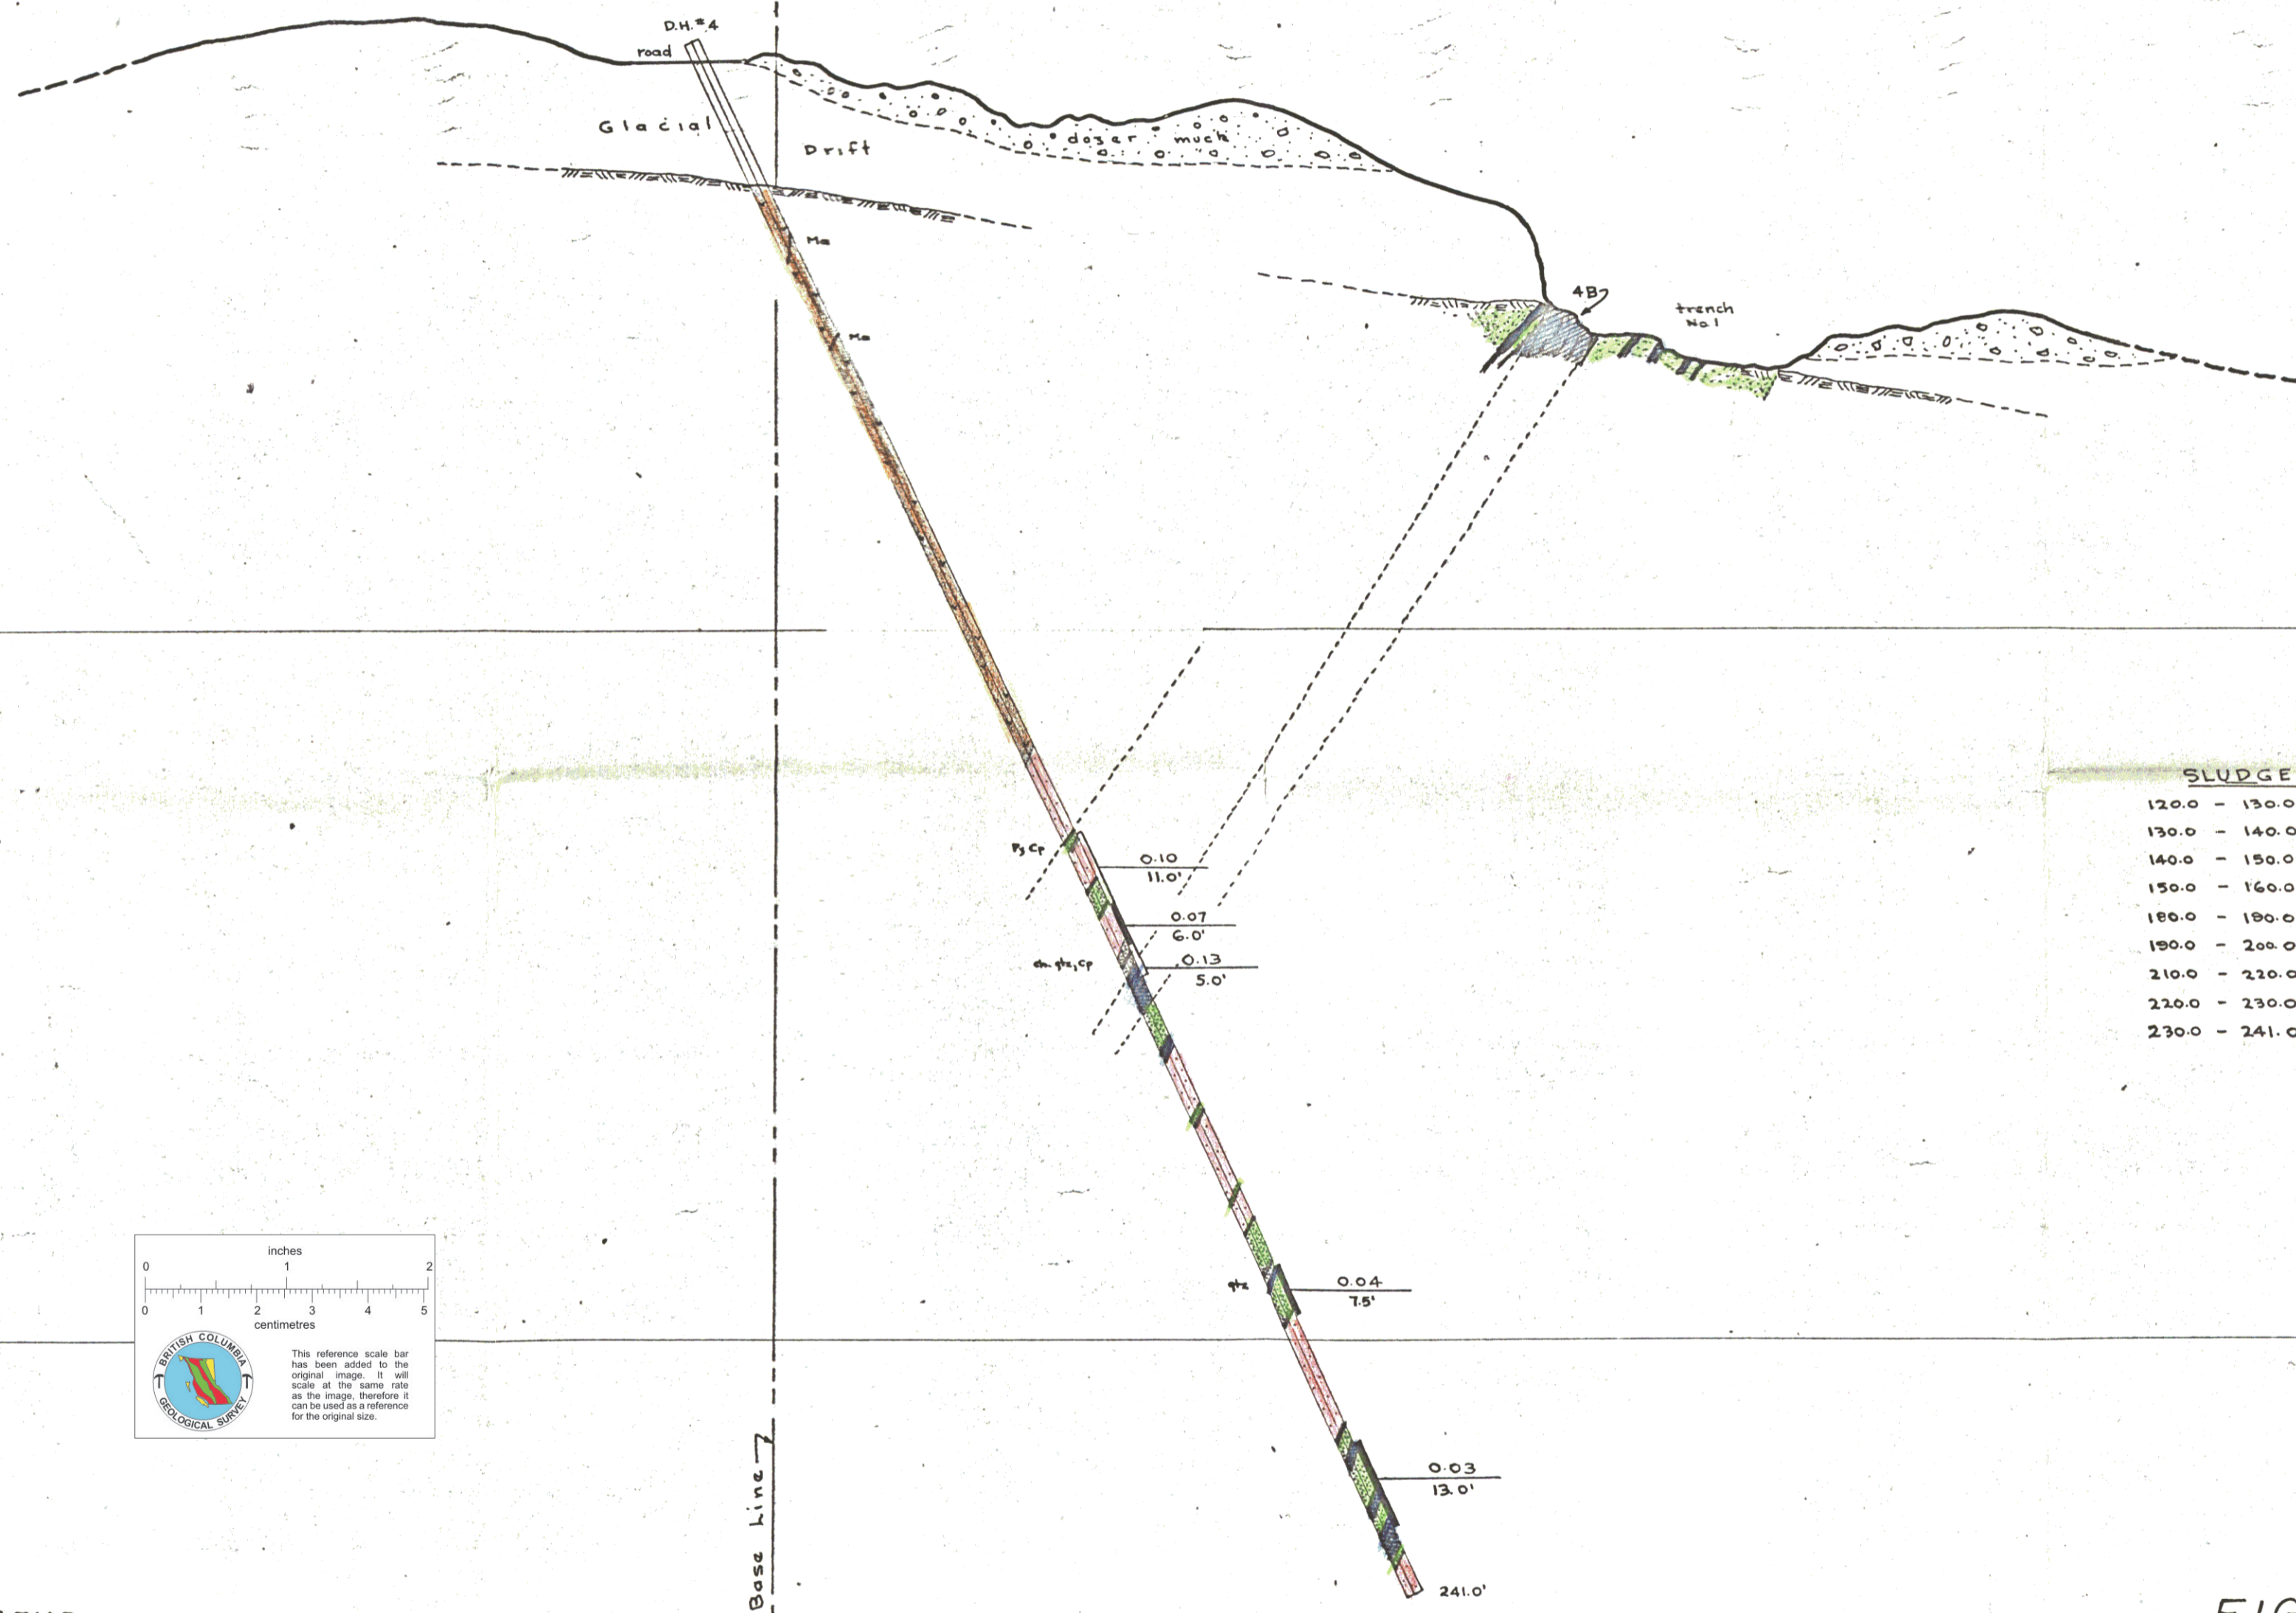

SLUDGE ASSAYS

120.0 - 130.0	10.0'	0.04% Cu
130.0 - 140.0	10.0'	0.07% Cu
140.0 - 150.0	10.0'	0.13% Cu
150.0 - 160.0	10.0'	0.05% Cu
160.0 - 190.0	10.0'	0.05% Cu
190.0 - 200.0	10.0'	0.05% Cu
210.0 - 220.0	10.0'	0.05% Cu
220.0 - 230.0	10.0'	0.06% Cu
230.0 - 241.0	11.0'	0.08% Cu

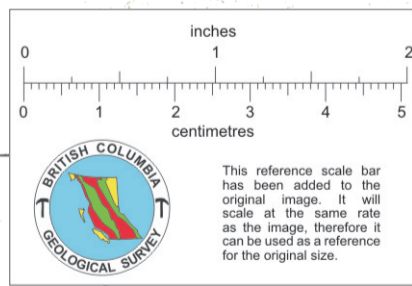

- LEGEND**
- Quartz Diorite: fine grain
 - "Pink" alteration
 - Chlorite-sericite alteration
 - Quartz Vein; Geogze (fault) zone
 - Malachite, pyrite, chalcopyrite
 - % copper over core length in ft.

FIGURE 8c
CHATAWAY EXPLORATION CO. LTD.
HIGHLAND VALLEY PROPERTY

CROSS SECTION
D.D.H. 4

010556

0 20 40 60
 Scale in Feet

DATE: 23 June, 1965 DRAWN BY: M. J. [Signature]