



A3 61° 00'

10,000

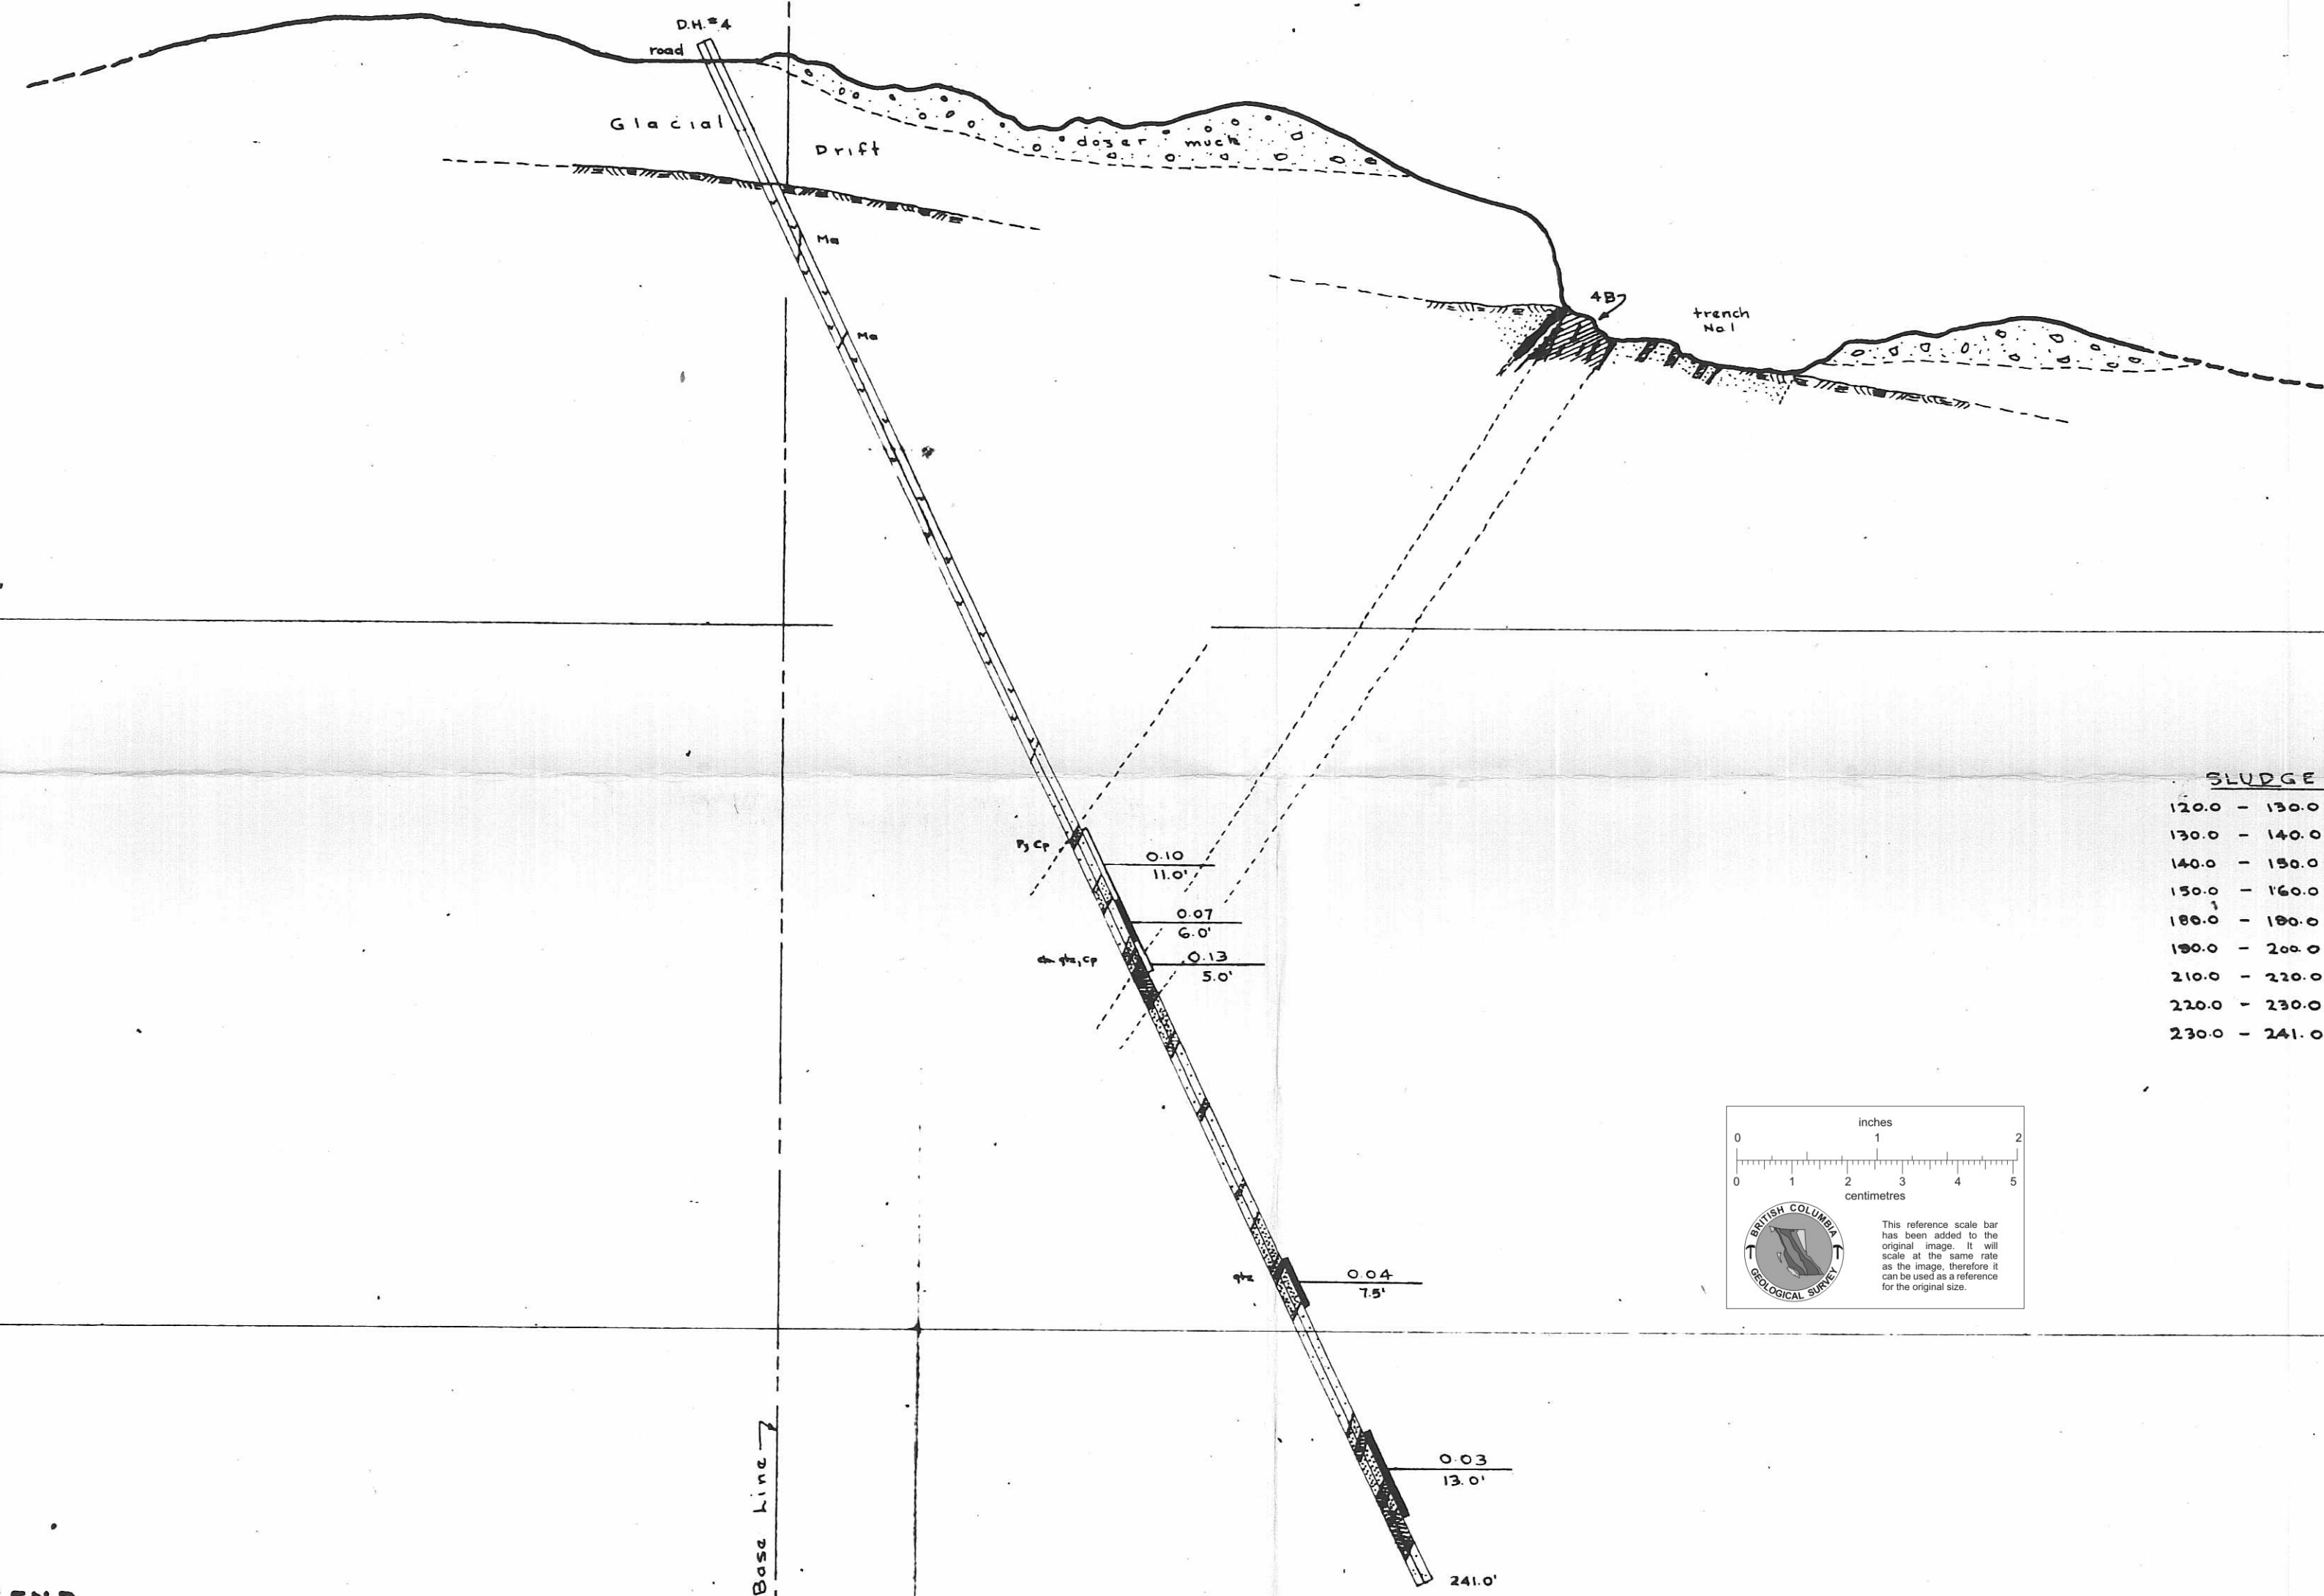

SLUDGE ASSAYS			
120.0 - 130.0	10.0'	0.04%	Cu
130.0 - 140.0	10.0'	0.07%	Cu
140.0 - 150.0	10.0'	0.13%	Cu
150.0 - 160.0	10.0'	0.05%	Cu
160.0 - 180.0	10.0'	0.05%	Cu
180.0 - 200.0	10.0'	0.05%	Cu
210.0 - 220.0	10.0'	0.05%	Cu
220.0 - 230.0	10.0'	0.06%	Cu
230.0 - 241.0	11.0'	0.08%	Cu

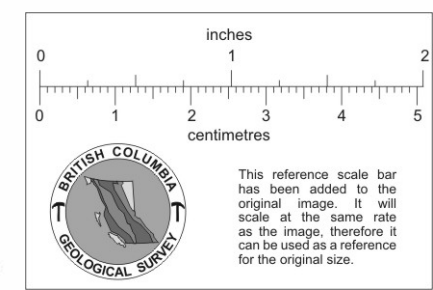

- LEGEND**
- Quartz Diorite: fine grain
 - "Pink" alteration
 - Chlorite-sericite alteration
 - Quartz vein; Gouge (fault)
 - Malachite, pyrite, chalcopyrite
 - % copper over core length

CHATAWAY EXPLORATION CO. LTD.
 HIGHLAND VALLEY PROPERTY

CROSS SECTION
D.D.H. 4

Scale in Feet

010562