
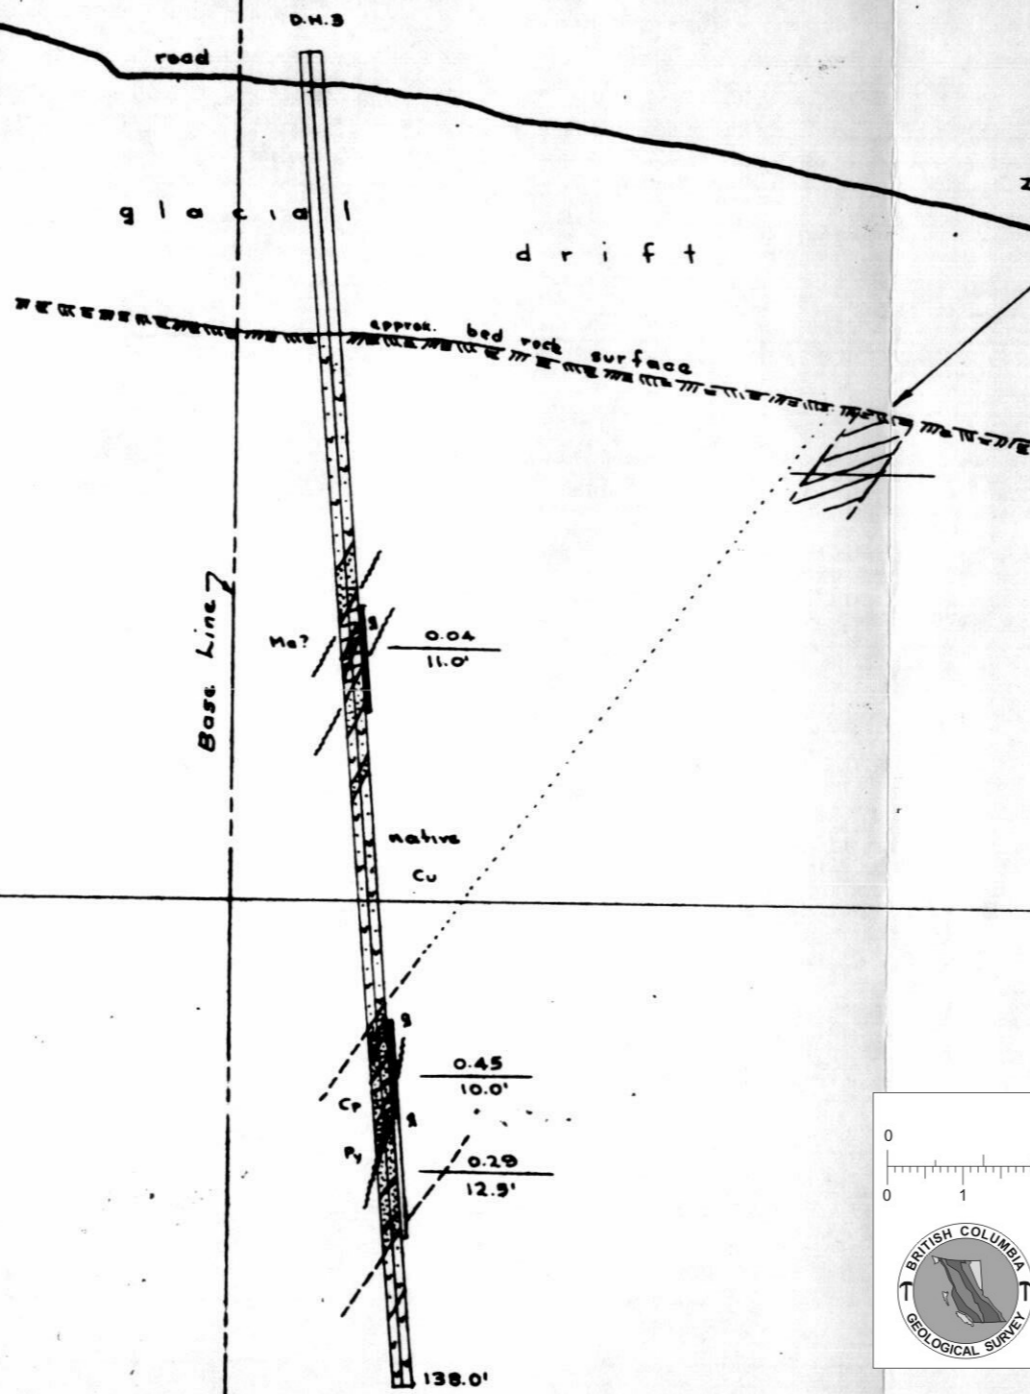


10000

10,000

Azimuth $61^{\circ} 00'$

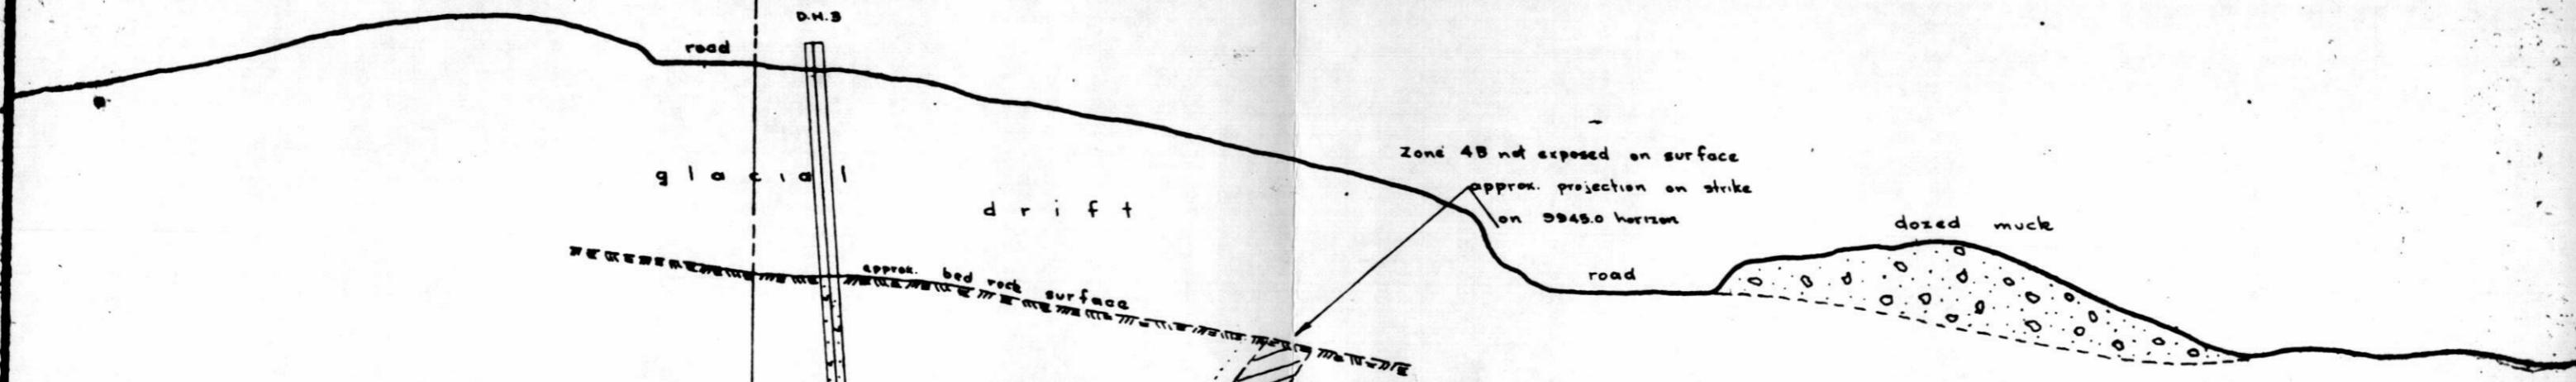

SLUDGE ASSAYS


50.0 - 60.0	10.0'	0.06 % Cu
60.0 - 70.0	10.0'	0.05 % Cu
90.0 - 100.0	10.0'	0.08 % Cu
100.0 - 110.0	10.0'	1.03 % Cu
110.0 - 120.0	10.0'	0.41 % Cu
120.0 - 130.0	10.0'	0.32 % Cu
130.0 - 138.0	10.0'	0.30 % Cu

9900

9900

LEGEND

- Quartz diorite - fine grain
- "Pink" alteration
- Chlorite-sericite alteration
- Quartz stringer ; gouge
- Malachite, chalcopyrite, pyrite
- % Copper over core length in feet

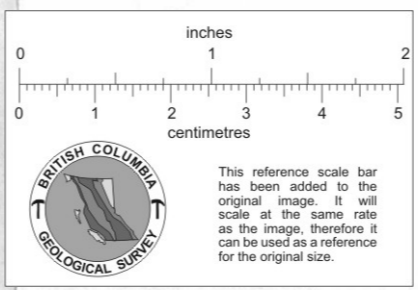

CHATAWAY EXPLORATION CO. LTD
HIGHLAND VALLEY PROPERTY

CROSS SECTION
D.D.H. 3

0 20 40 60
 Scale in Feet

DATE: 9 June 1968 DRAWN BY: [Signature]

010565