



61° 05'

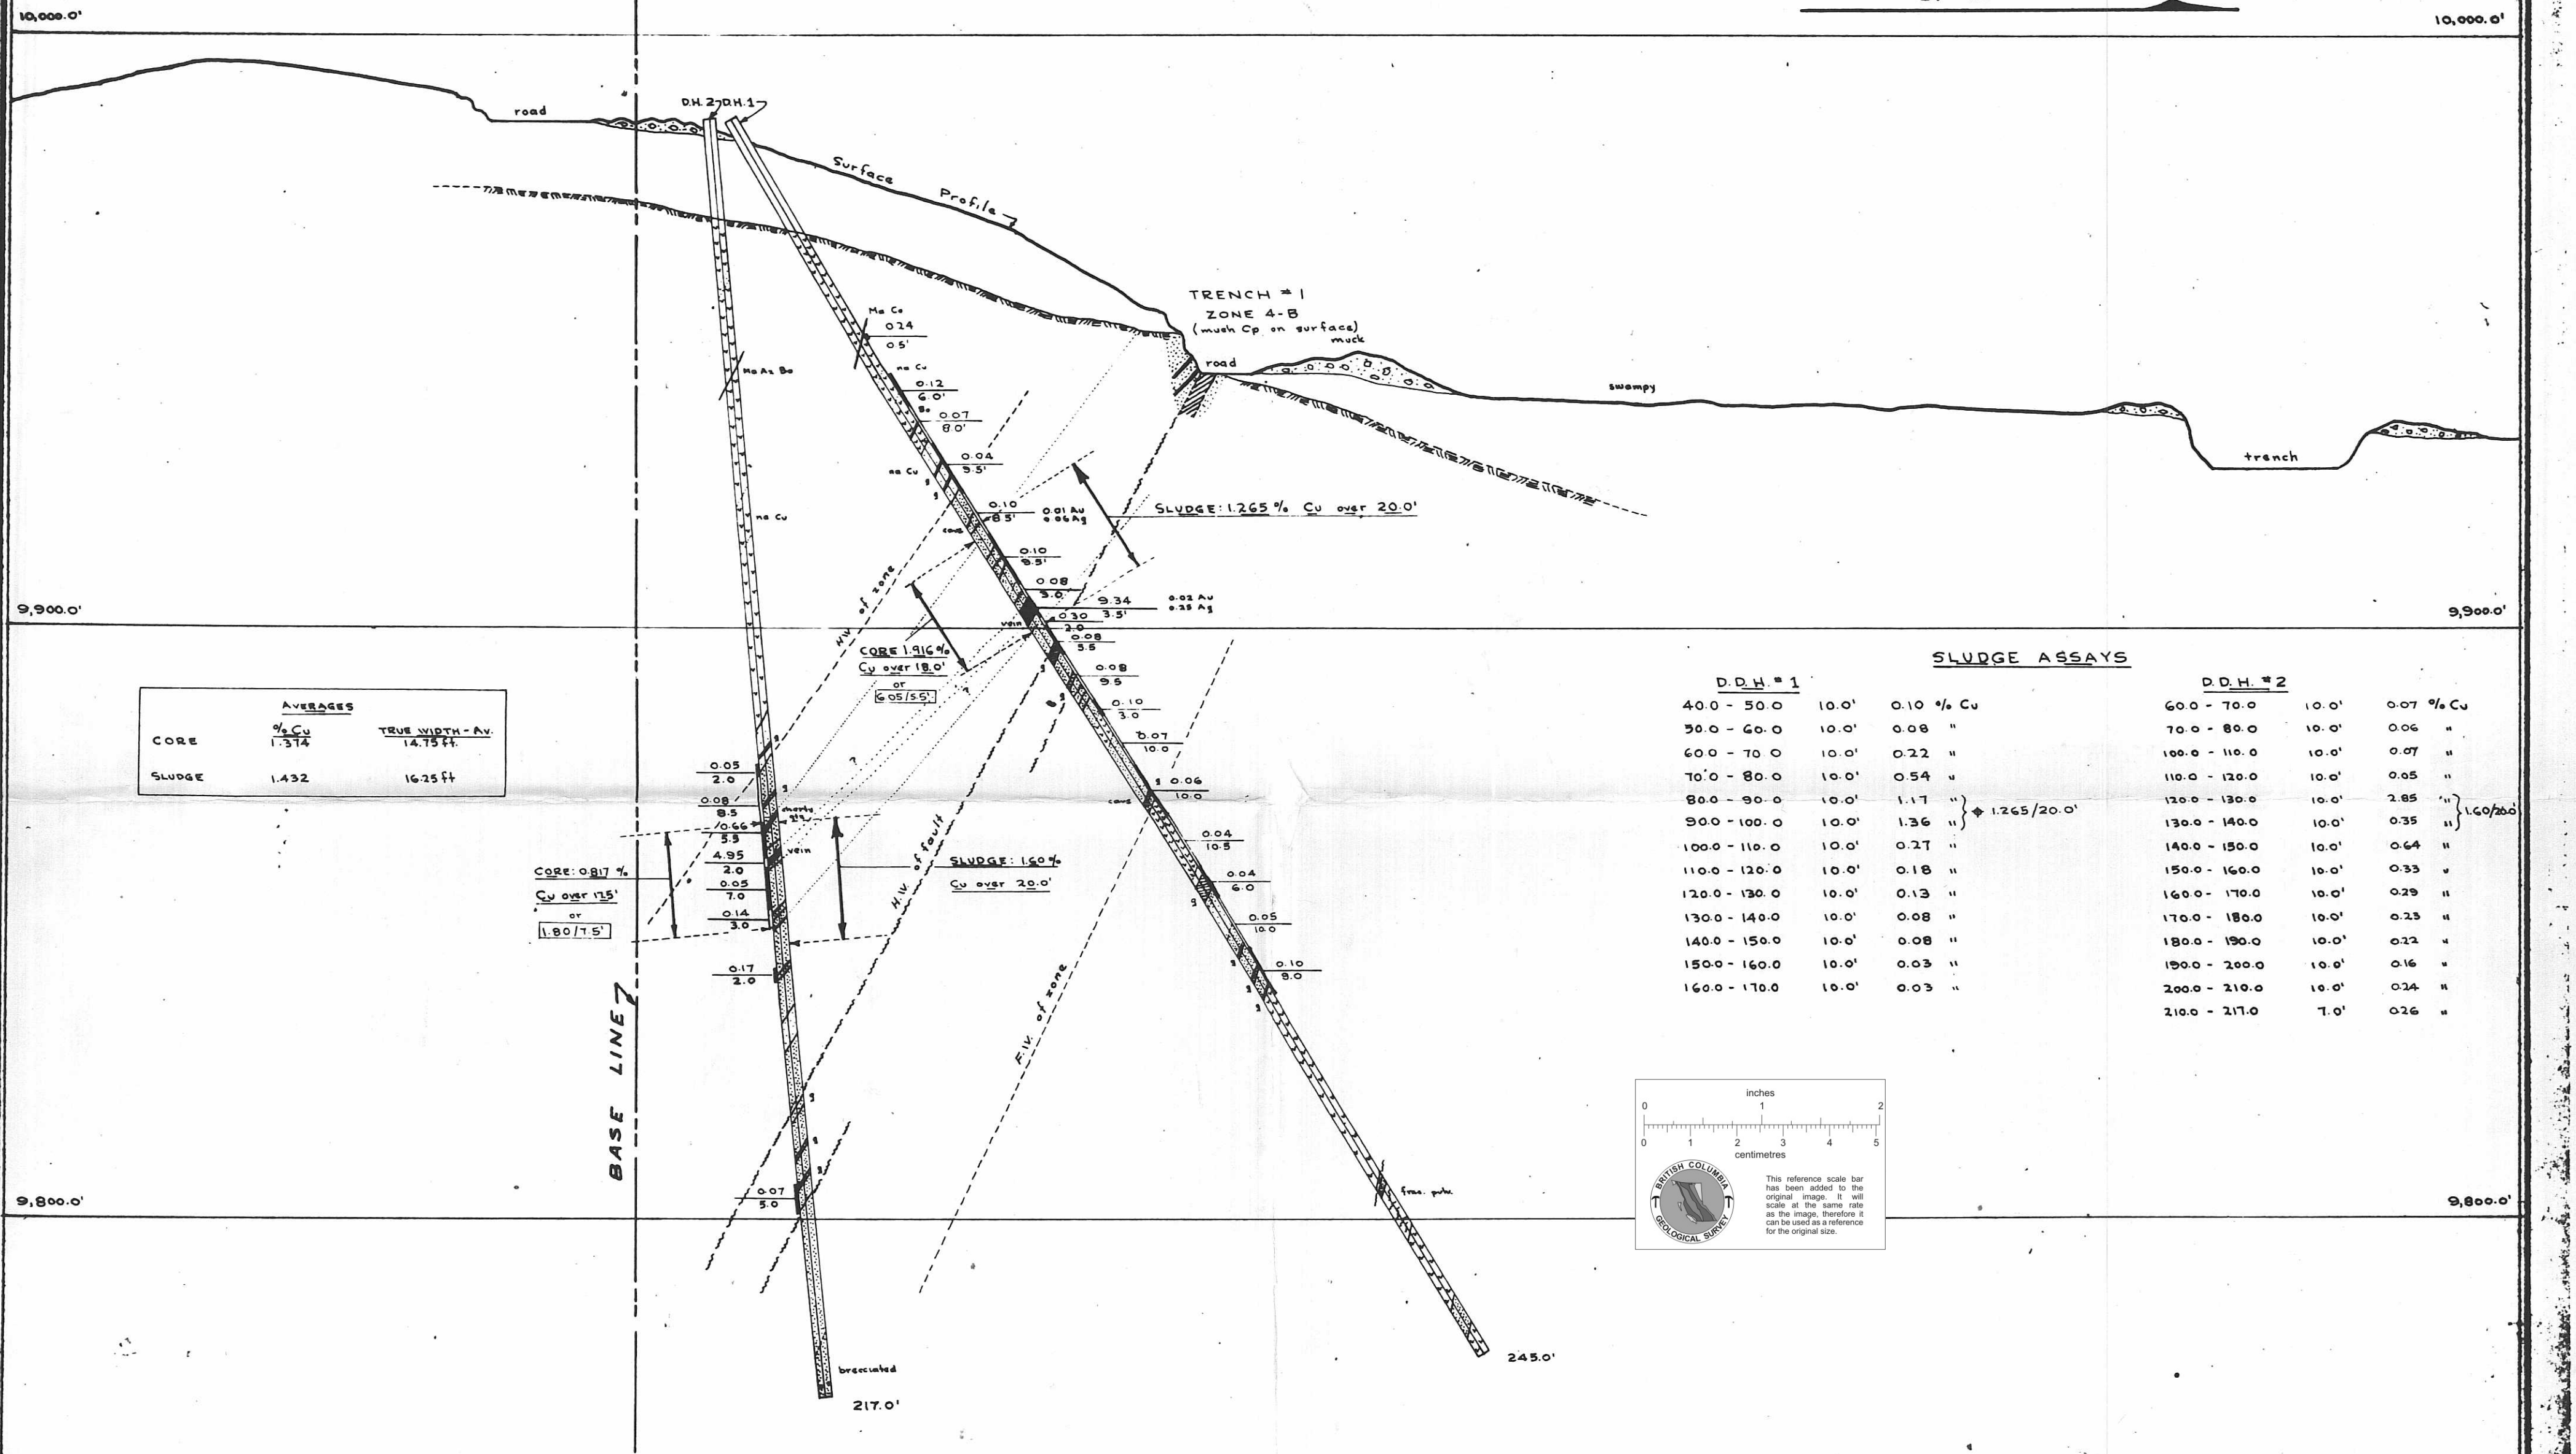

AVERAGES		
	% Cu	TRUE WIDTH - Av.
CORE	1.374	14.75 ft.
SLUDGE	1.432	16.25 ft.

SLUDGE ASSAYS			
D.D.H. #1		D.D.H. #2	
40.0 - 50.0	10.0'	0.10 % Cu	60.0 - 70.0 10.0' 0.07 % Cu
50.0 - 60.0	10.0'	0.08 "	70.0 - 80.0 10.0' 0.06 "
60.0 - 70.0	10.0'	0.22 "	100.0 - 110.0 10.0' 0.07 "
70.0 - 80.0	10.0'	0.54 "	110.0 - 120.0 10.0' 0.05 "
80.0 - 90.0	10.0'	1.17 "	120.0 - 130.0 10.0' 2.85 "
90.0 - 100.0	10.0'	1.36 "	130.0 - 140.0 10.0' 0.35 "
100.0 - 110.0	10.0'	0.27 "	140.0 - 150.0 10.0' 0.64 "
110.0 - 120.0	10.0'	0.18 "	150.0 - 160.0 10.0' 0.33 "
120.0 - 130.0	10.0'	0.13 "	160.0 - 170.0 10.0' 0.29 "
130.0 - 140.0	10.0'	0.08 "	170.0 - 180.0 10.0' 0.23 "
140.0 - 150.0	10.0'	0.08 "	180.0 - 190.0 10.0' 0.22 "
150.0 - 160.0	10.0'	0.03 "	190.0 - 200.0 10.0' 0.16 "
160.0 - 170.0	10.0'	0.03 "	200.0 - 210.0 10.0' 0.24 "
			210.0 - 217.0 7.0' 0.26 "

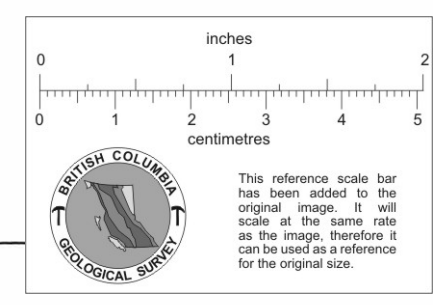

- LEGEND**
- Quartz Diorite - fine grain
 - "Pink" alteration
 - "Ore-type" alteration (chlorite, sericite, etc.)
 - Quartz vein; Gouge zone
 - Malachite, Azurite, Chalcopyrite, Bornite, Chalcocite
 - % Copper over core length in feet

CHATAWAY EXPLORATION CO. LTD.
HIGHLAND VALLEY PROPERTY

CROSS SECTION
D.D.H. 1 and 2

0 20 40 60
Scale in Feet

DATE: 4 June 1965 DRAWN BY: [Signature]

010567