


PROPERTY FILE

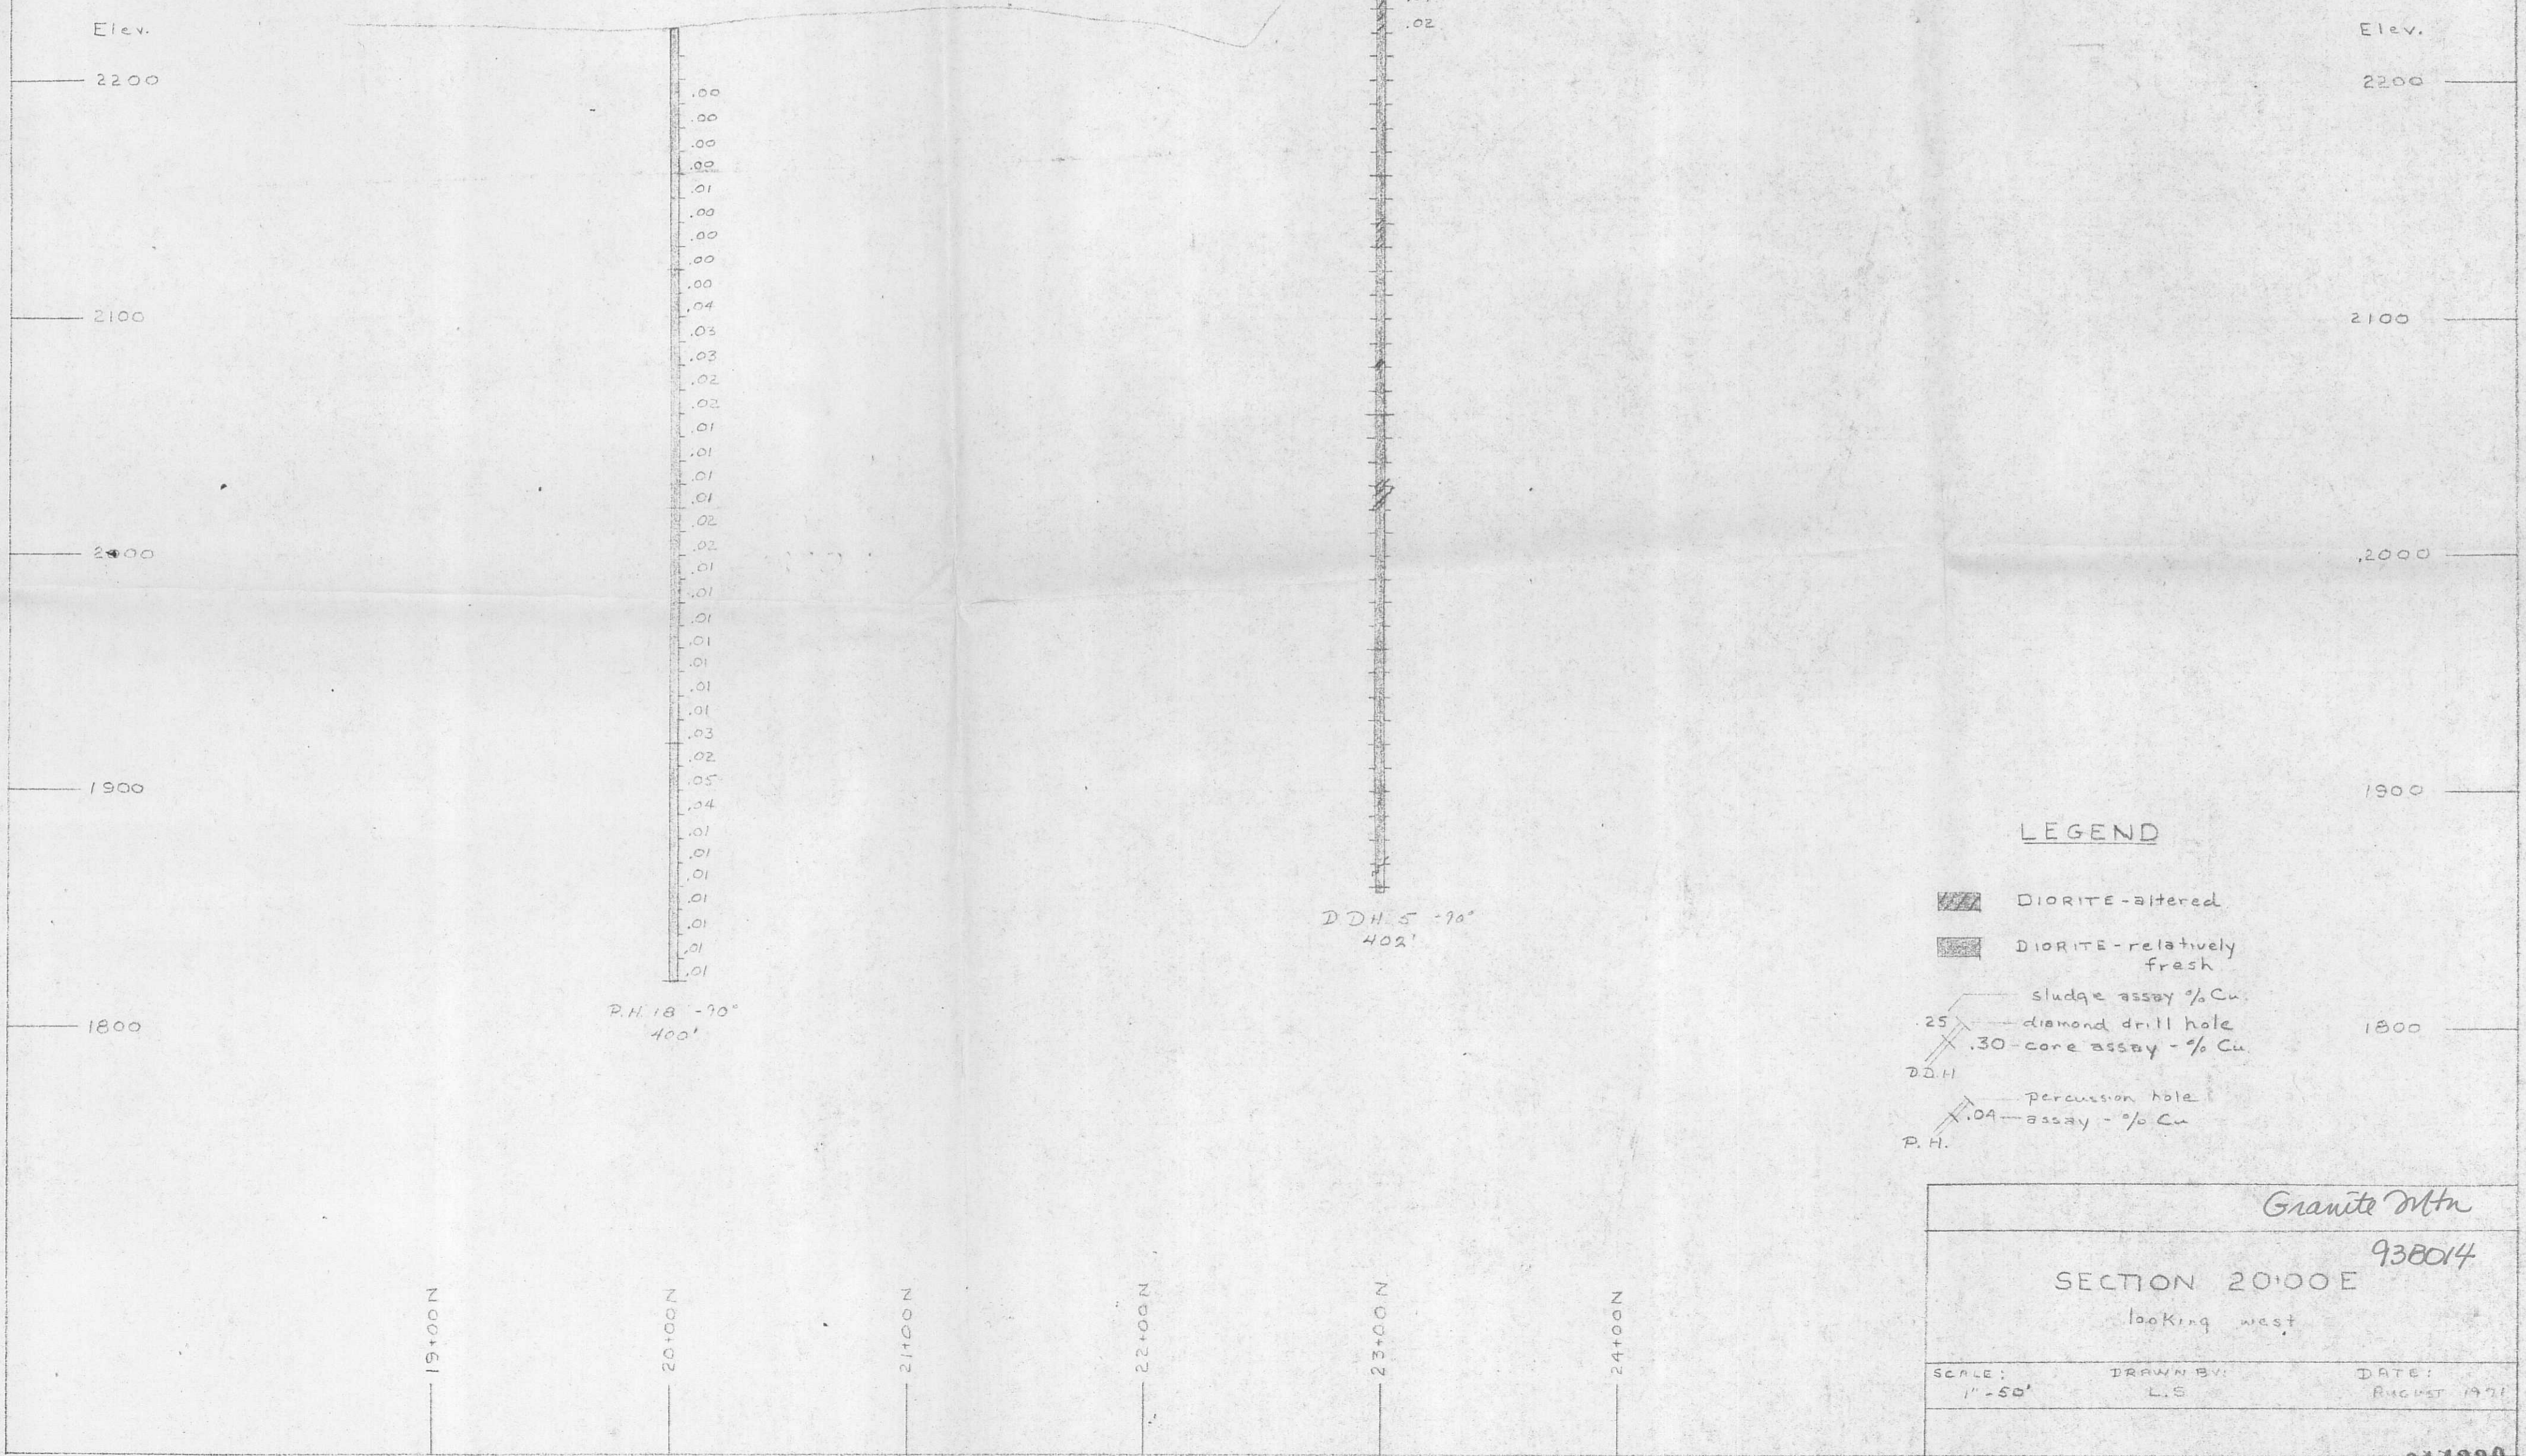

LEGEND

- DIORITE-altered
- DIORITE-relatively fresh
- sludge assay % Cu
- .25 diamond drill hole
- .30-core assay - % Cu
- D.D.H.
- percussion hole
- .04-assay - % Cu
- P.H.

Granite Mtn		
938014		
SECTION 20'00E		
looking west		
SCALE:	DRAWN BY:	DATE:
1"=50'	L.S.	AUGUST 1971