
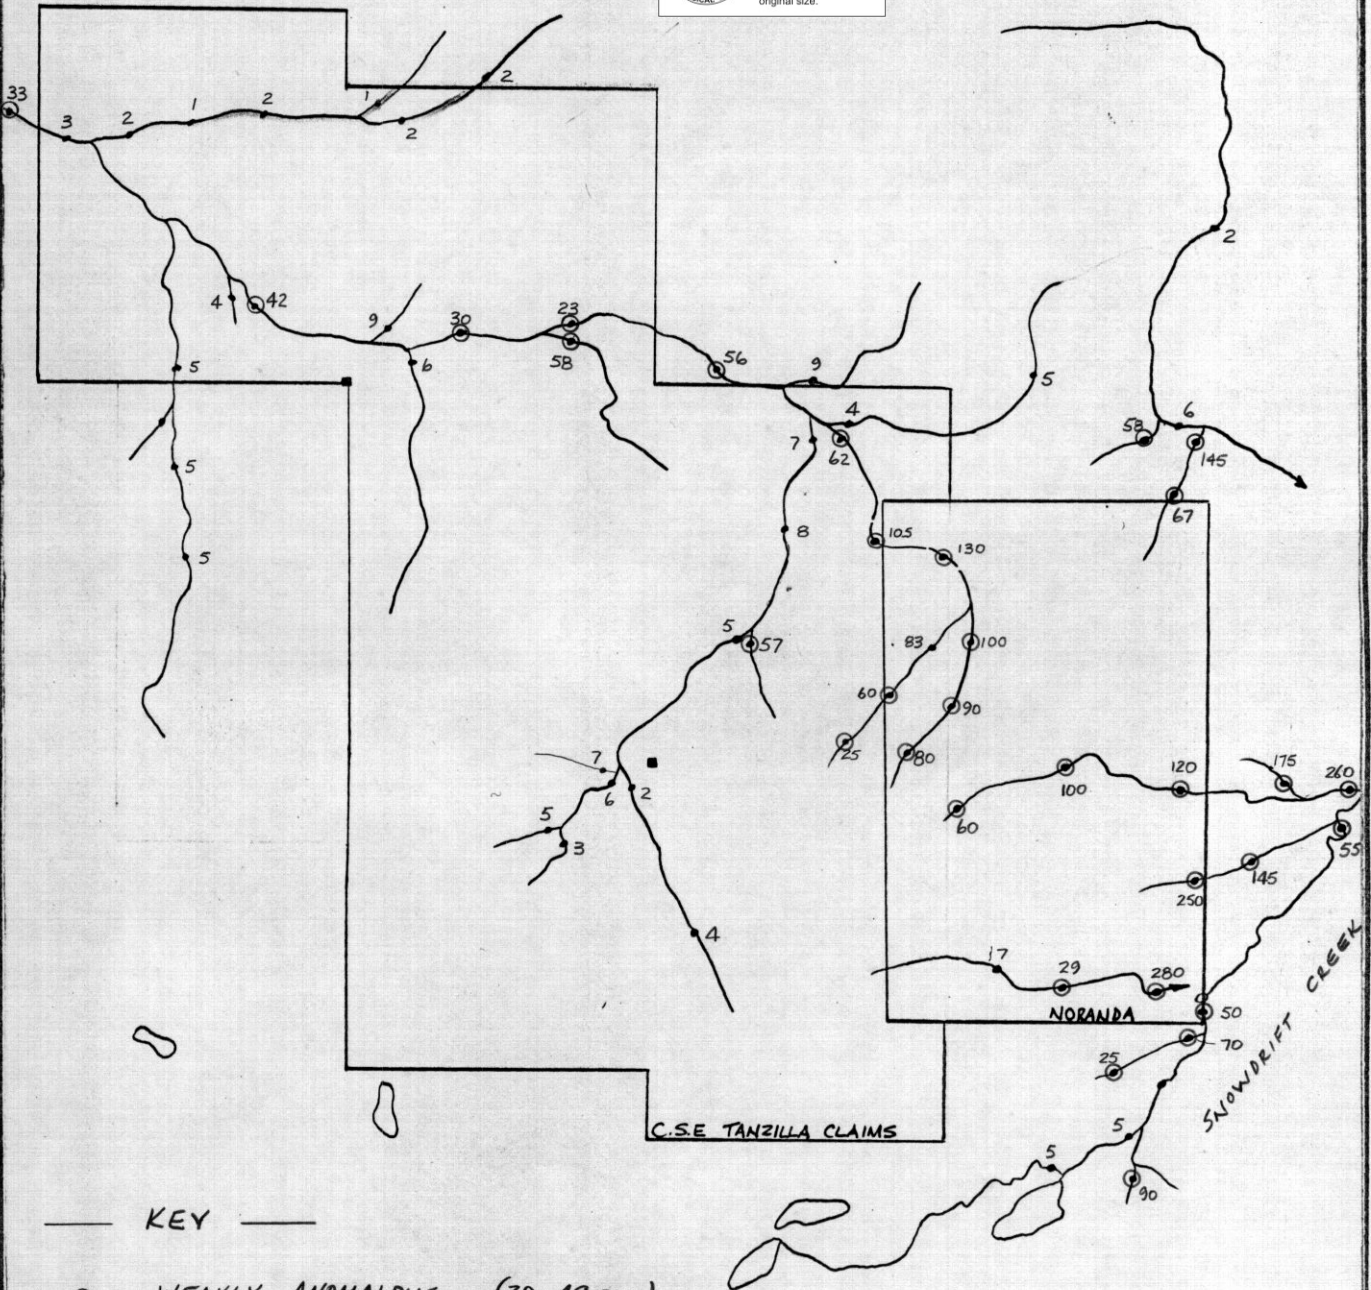


104I 050 T-4



- KEY —
- WEAKLY ANOMALOUS (20-49 ppm)
 - ANOMALOUS (50-99 ppm)
 - STRONGLY ANOMALOUS (≥100 ppm)

NOTE: ALL W VALUES ≤ 10 ppm

NTS 104 I/5E

CANADIAN SUPERIOR EXPLORATION LIMITED
SMITHERS REGIONAL OFFICE

CASSIAR PROJECT
TANZILLA CLAIMS
ppm Mo IN SILTS

DRAUGHTSMAN: JB	SCALE: 1:50,000	DATE: Dec/78
-----------------	-----------------	--------------

019829