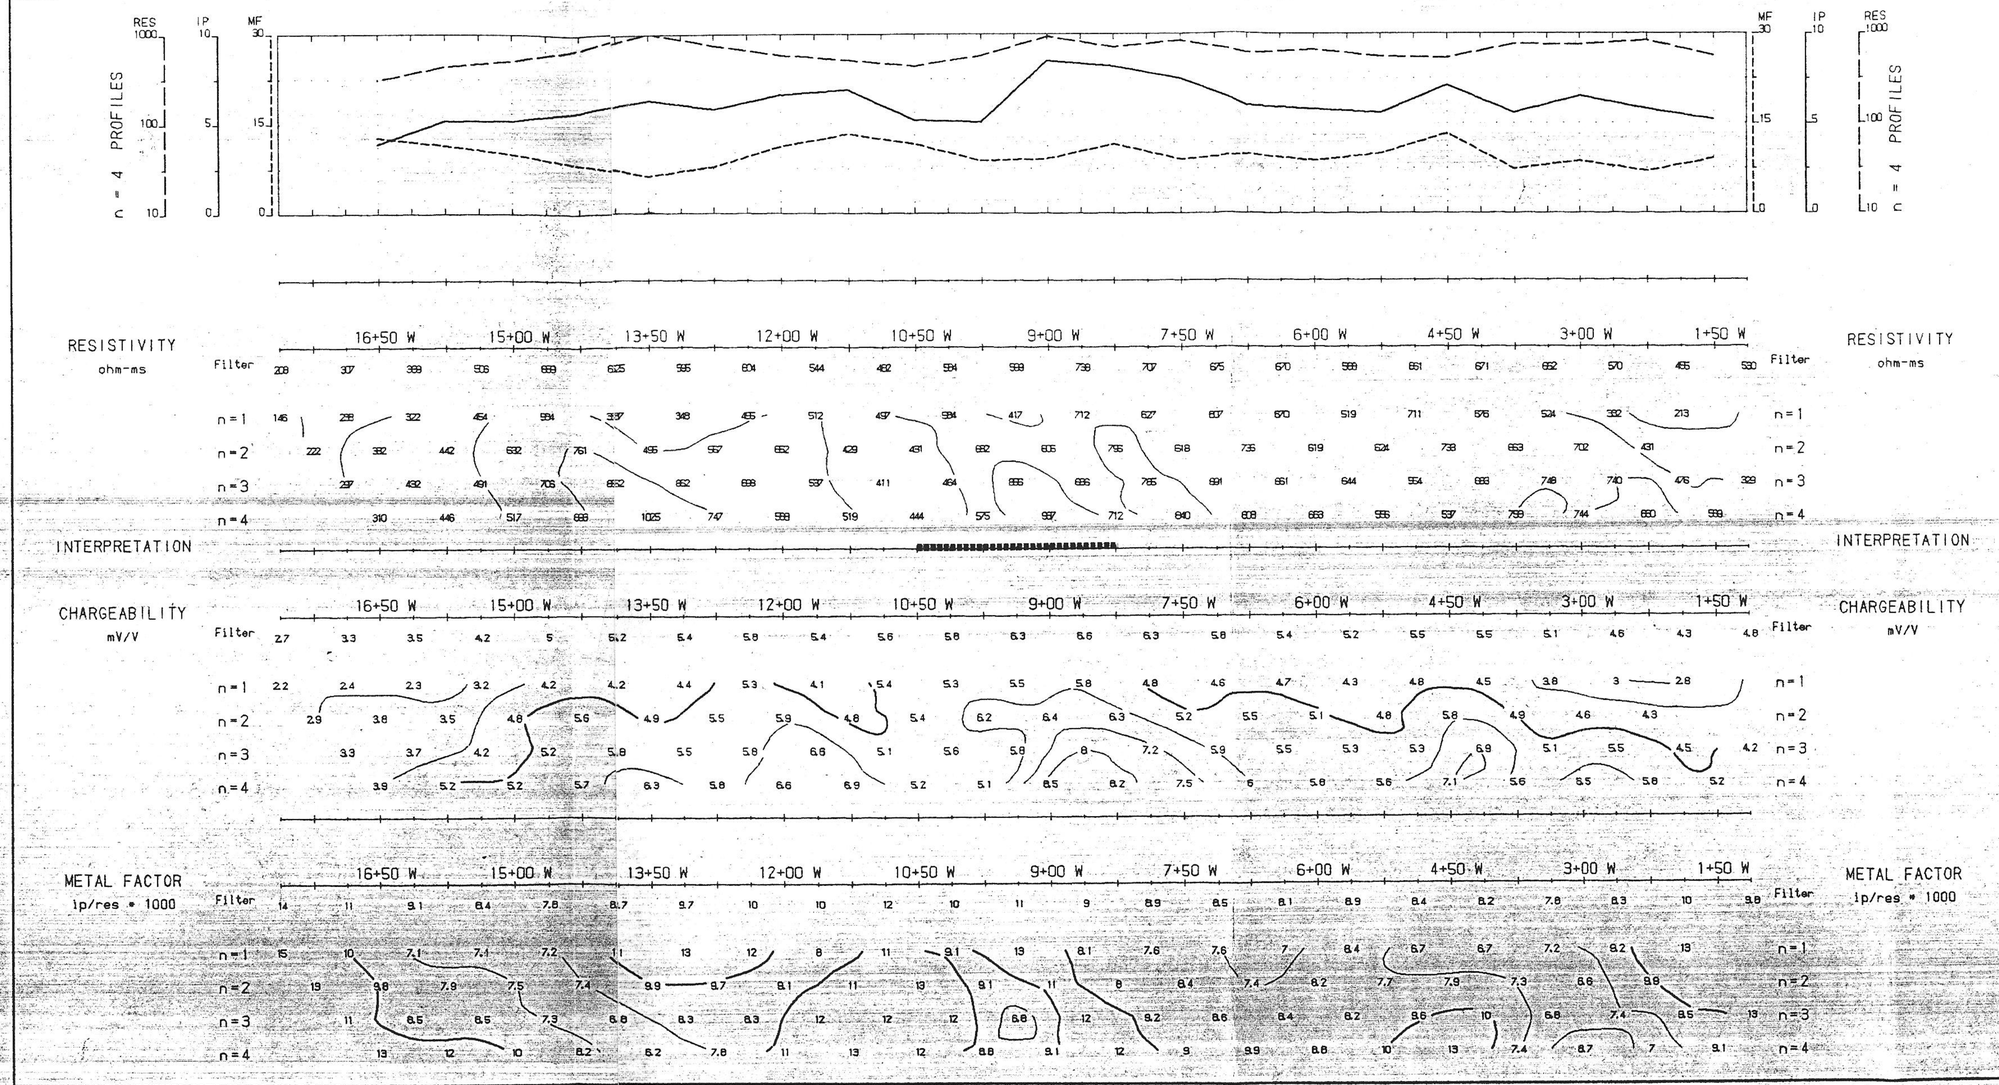

Line 0 N

Dipole-Pole Array

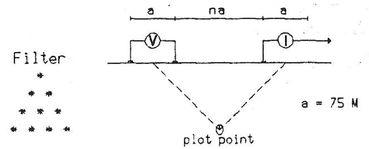

Instrument: Huntec 2.5 kw. Tx., BRGM IP6 Rx.
Frequency: 0.125 Hz.
Operators: P.E.W., A.W.

Logarithmic Contours 1, 1.5, 2, 3, 5, 7.5, 10,...

INTERPRETATION

Well defined, strong increase in polarization with or without marked decrease in resistivity.

Fairly well defined moderate increase in polarization.

Fairly well defined weak increase in polarization.

Resistivity feature.



Scale 1:5000

50 0 50 100 150 200 250
(metres)

520459

AUCUMO RESOURCES LTD.

INDUCED POLARIZATION SURVEY
CVS CLAIMS, KAMLOOPS MINING DIVISION
HIGHLAND VALLEY, BRITISH COLUMBIA

Date: MAY, 1992 N.T.S.: 92 I/7W
Interpretation: P.E.W.

PETER E. WALCOTT & ASSOC. LTD.