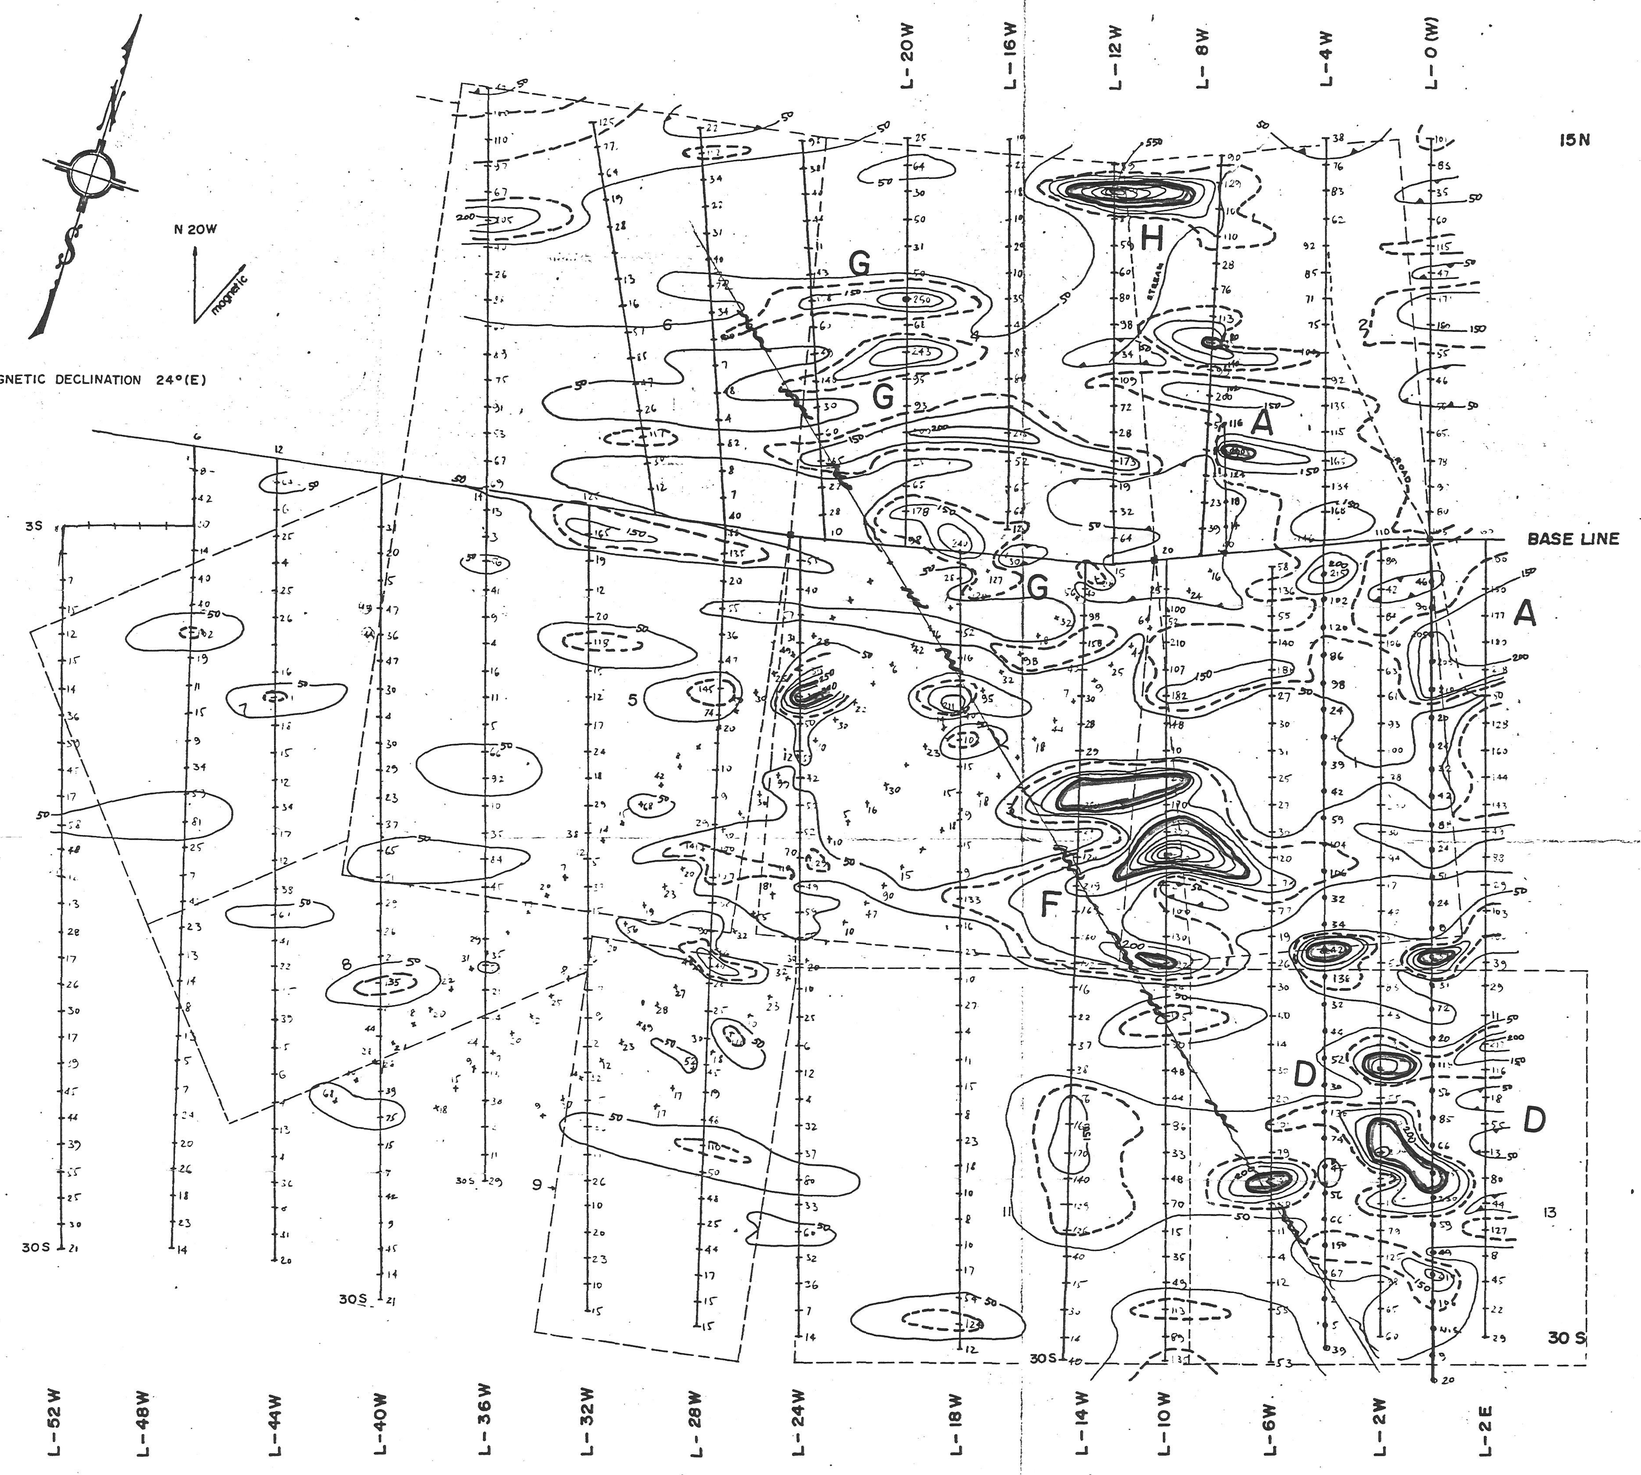

LEGEND

SURVEY LINE FROM 1970

SURVEY LINE & STATIONS

(ALSO STATIONS)

CLAIM POST

2 CLAIM No.

CLAIM LINE

CONTOURS

CONTOUR INTERVAL IS 50 ppm

MEAN BACKGROUND VALUE 40 ppm

SUBANOMALOUS THRESHOLD VALUE 107 ppm (say 100)

ANOMALOUS THRESHOLD VALUE 280ppm (250 ppm contour)

inches 0 1 2

0 1 2 3 4 5 centimetres

BRITISH COLUMBIA GEOLOGICAL SURVEY

This reference scale bar has been added to the original image. Consequently, it will scale at the same rate as the image, therefore it can be used as a reference for the original size.

TO ACCOMPANY GEOCHEMICAL REPORT BY D.G. MARK, B.Sc.

EXETER MINES LTD. (NPL)

GUS CLAIMS

Hendrix Lake, Cariboo M.D.

GEOCHEMISTRY – SOIL SAMPLING

(type of survey) *COPPER — Survey plan and Contours*

scale	date	job no.	sheet no.	drawn by
1" – 400'	JUNE 1971	71 – 58		P. P.

Geotronics Surveys Ltd.

Geophysical Surveys, Ground & Airborne

527 – 602 West Hastings Street, Vancouver, British Columbia.

NTS 93 A/2 W

520749