
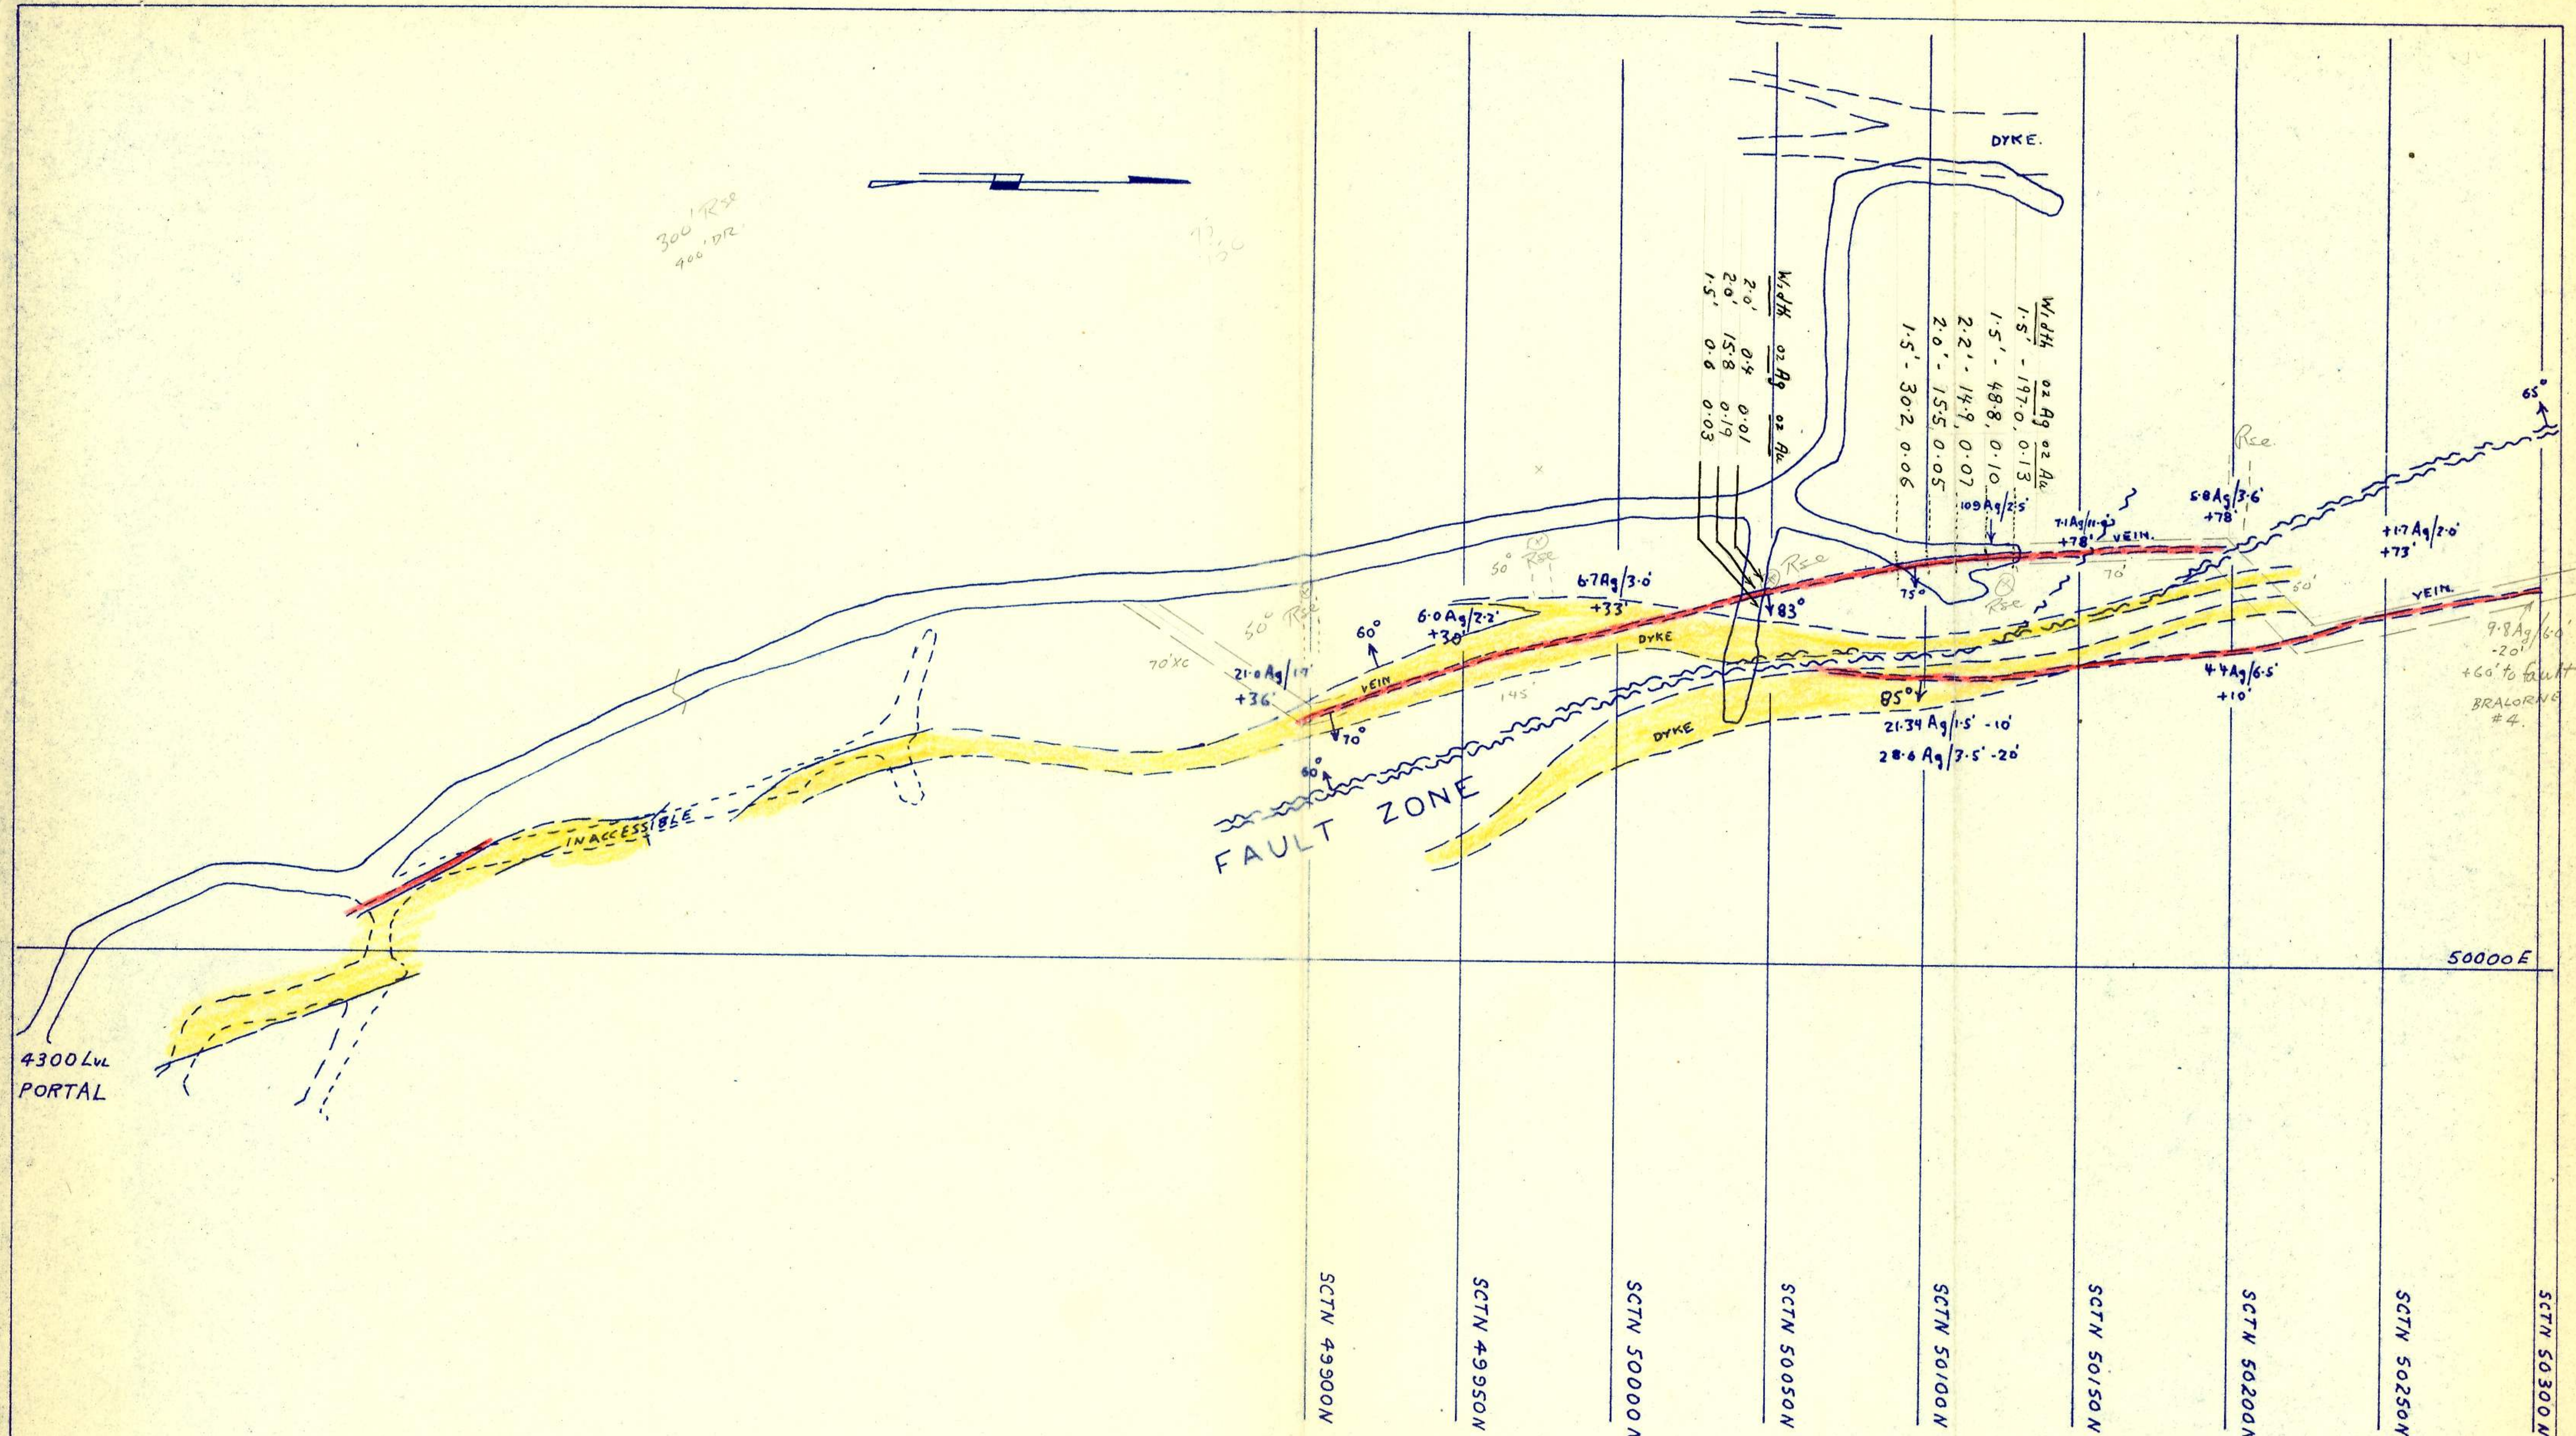


300' R30
400' DR

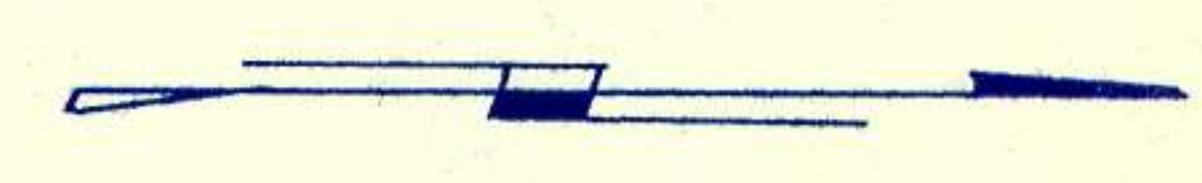

4300 Lvl
PORTAL

INACCESSIBLE

FAULT ZONE

DYKE

DYKE

DYKE


VEIN

VEIN

9.8 Ag/6.0
-20'
to fault
BRALORNE
#4


SCTN 49900N
SCTN 49950N
SCTN 50000N
SCTN 50050N
SCTN 50100N
SCTN 50150N
SCTN 50200N
SCTN 50250N
SCTN 50300N

50000E

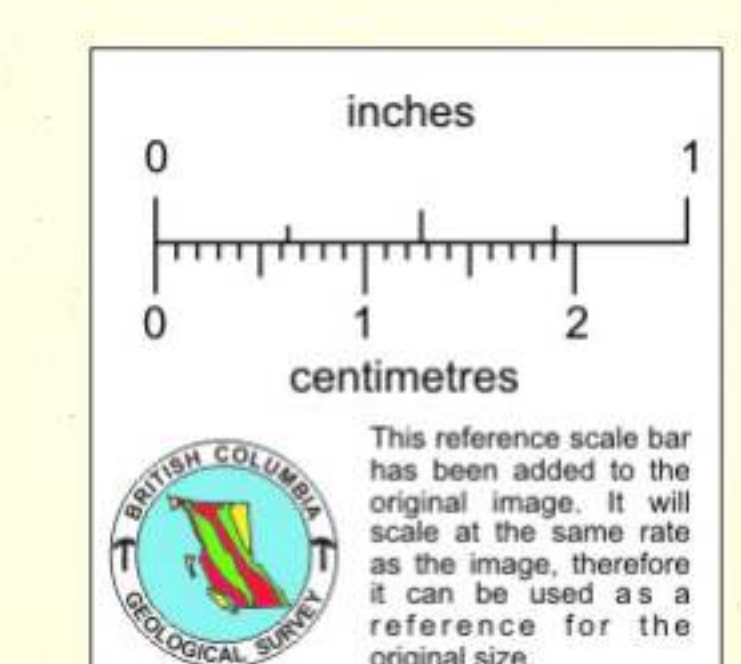


PLAN VIEW - 4300 LEVEL
No. 1 ZONE
1" = 50'

673126

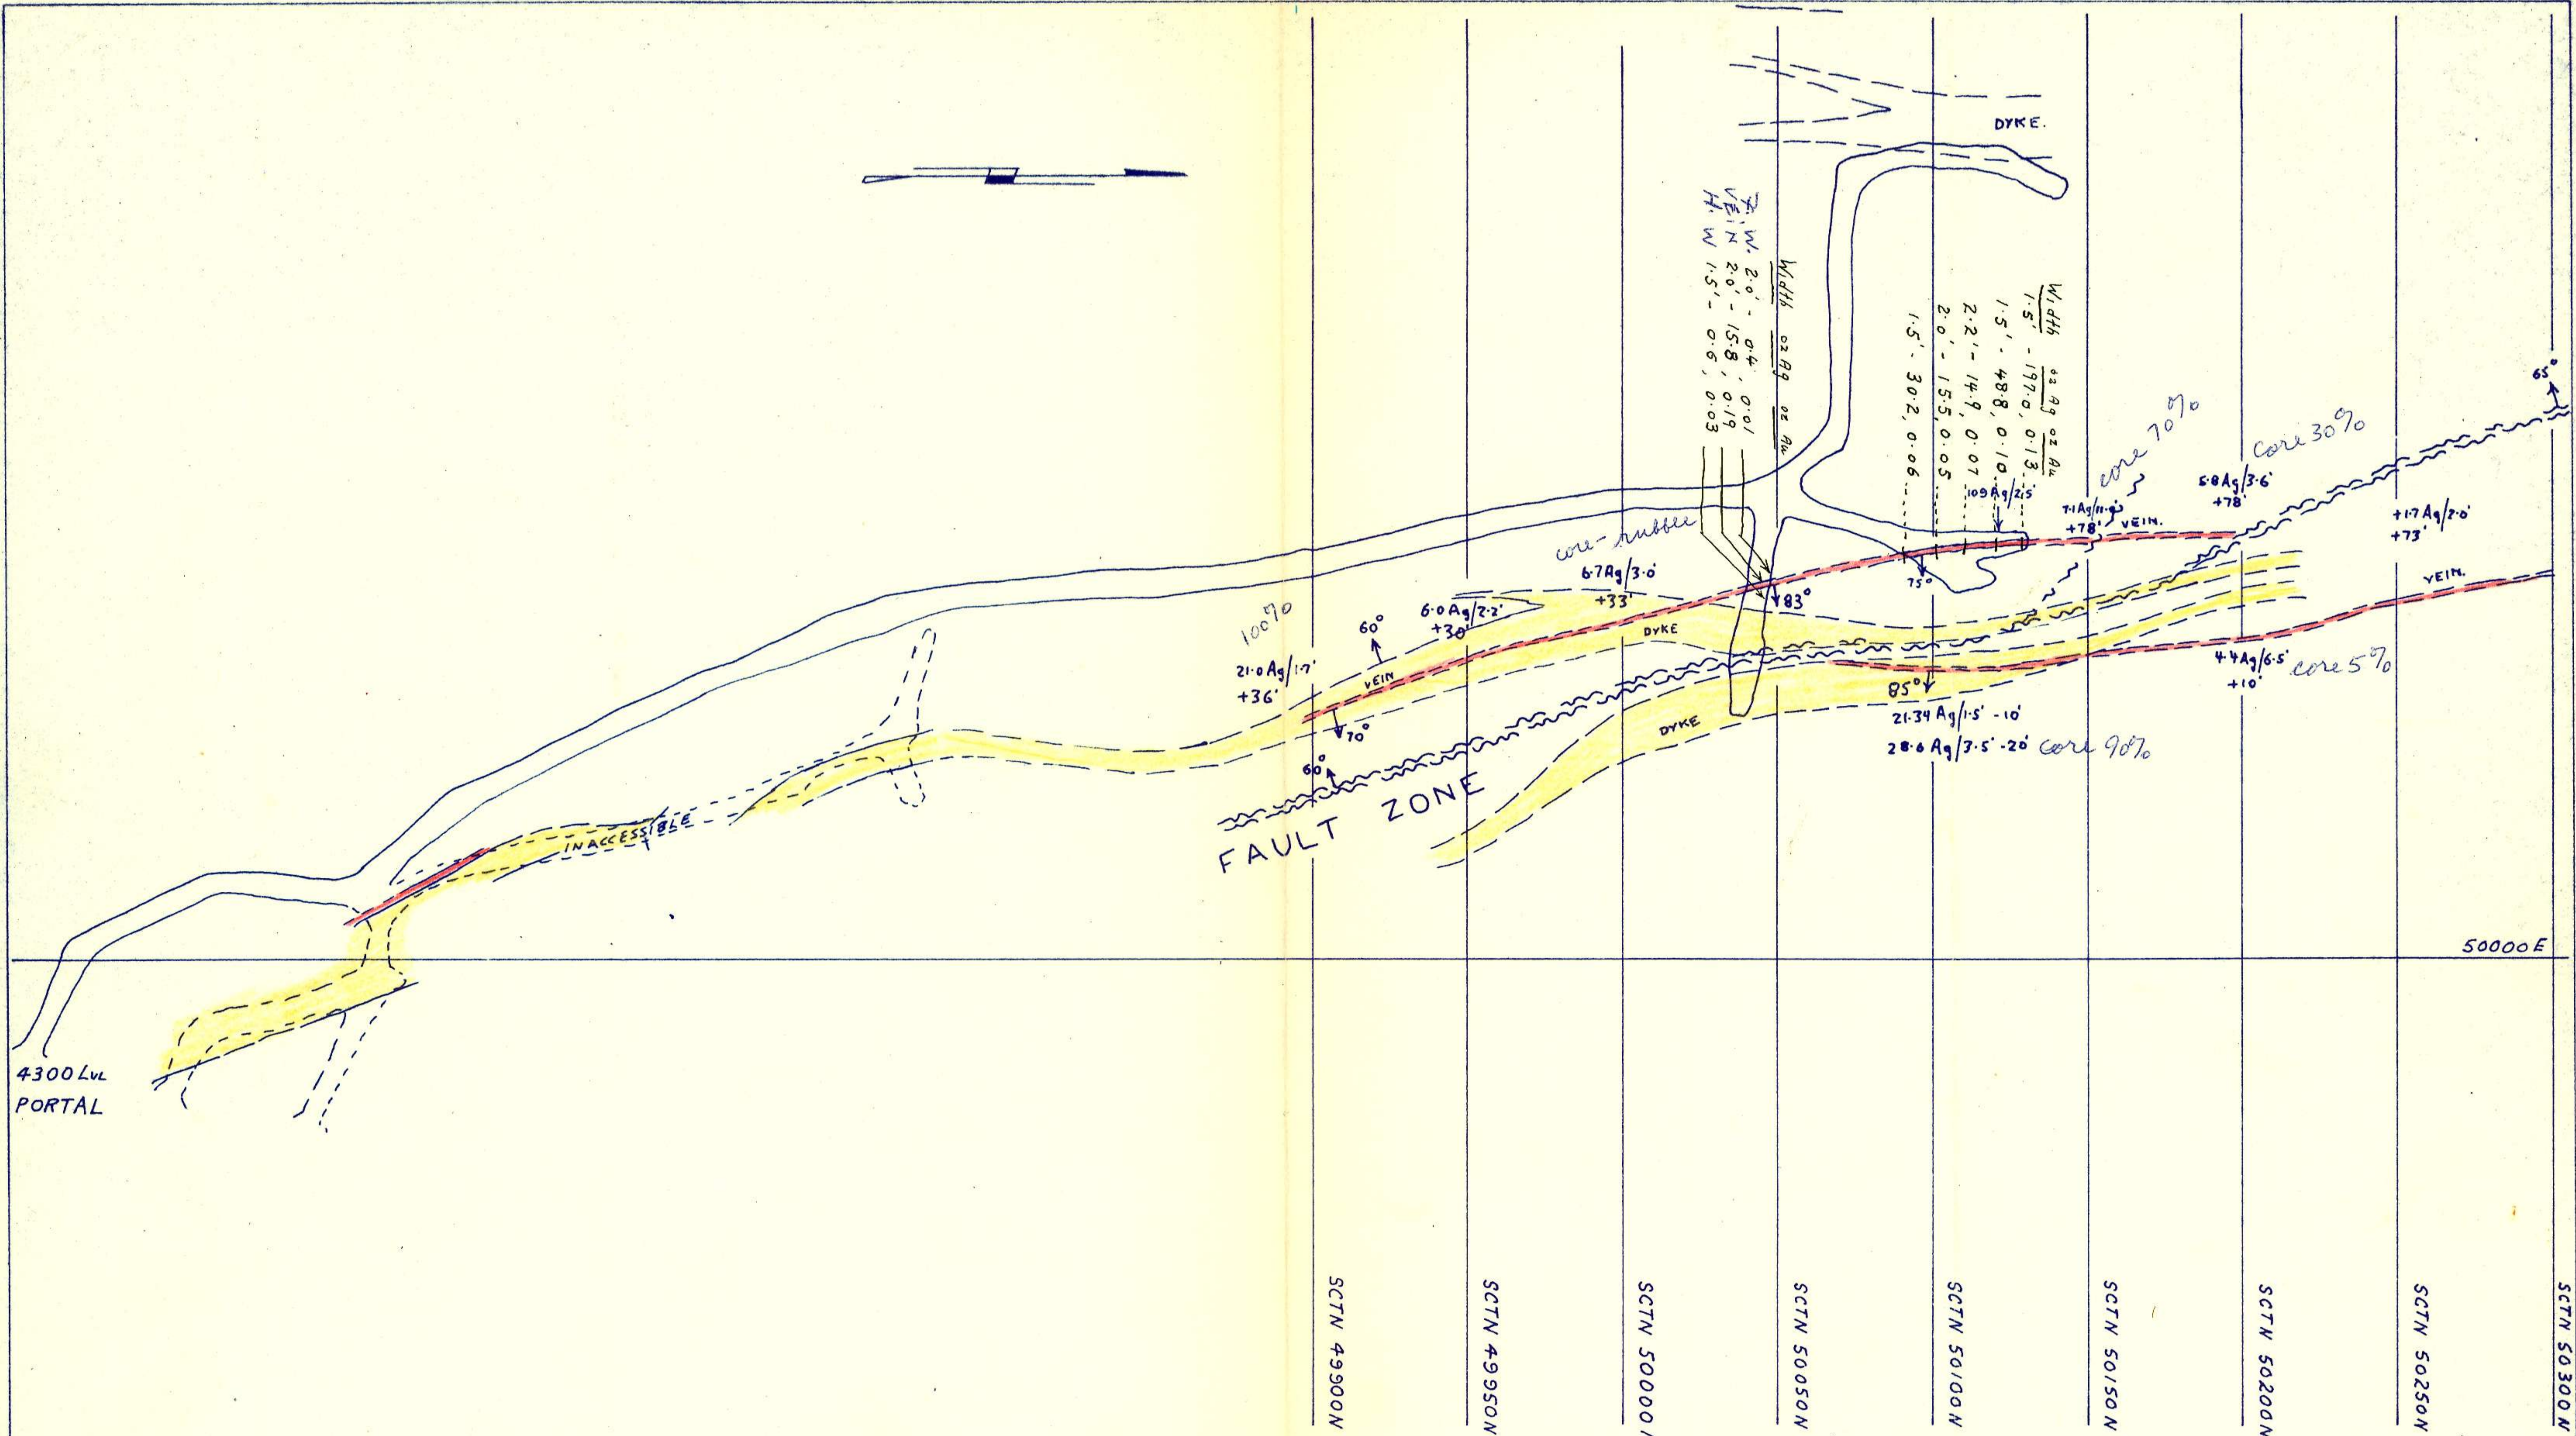

FELDSPAR PORPHYRY
 SULPHIDES

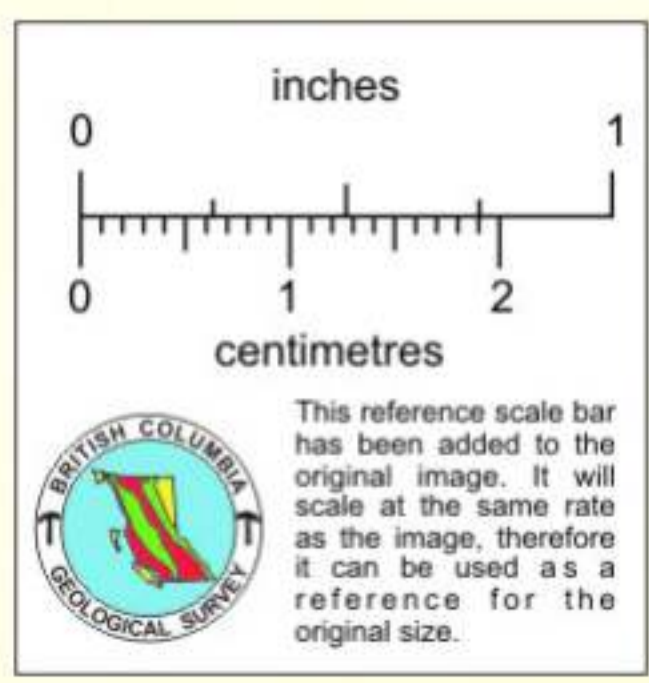

PLAN VIEW - 4300 LEVEL
 No. 1 ZONE
 1" = 50'