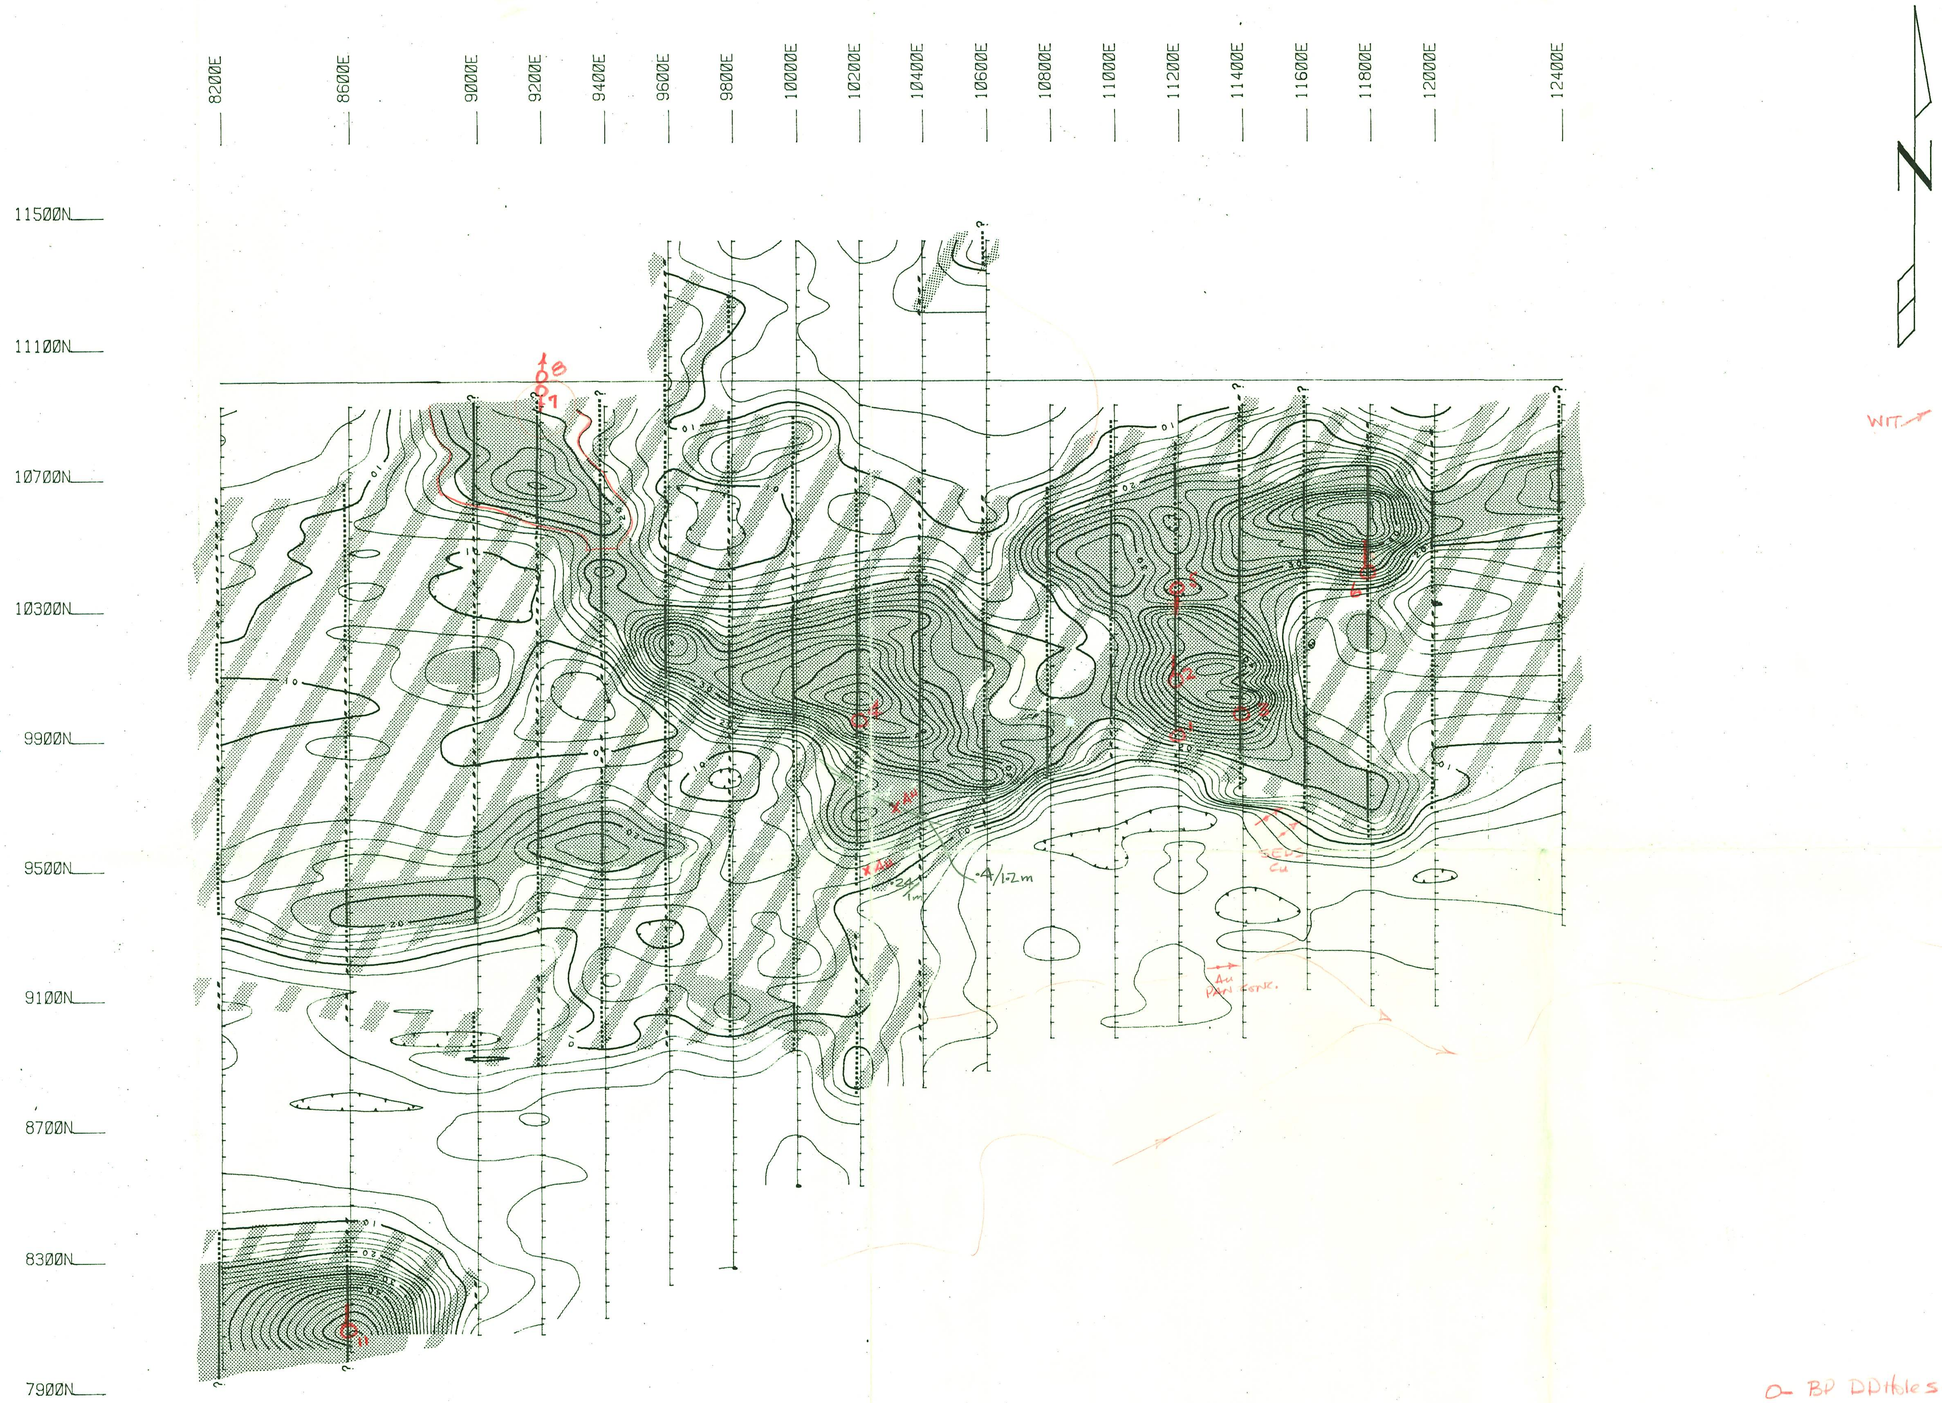

To accompany report by P.A. Cartwright and M.J. Cormier dated April 30,1991.

IP Anomaly Class

Strong
Moderate
Weak

Outline of Anomalous IP Zone

STRONGLY ANOMALOUS

ANOMALOUS

Approved: PAC
April 30,1991

inches
0 1 2
0 1 2 3 4 5
centimetres

This reference scale bar has been added to the original image. It will scale at the same rate as the image, therefore it can be used as a reference for the original size.

Instrument : IP-6

Array:Pole-Dipole.a=50m.n=1-4.
Current Electrode to the south.
Contour Interval : 2 msec
Filter: 10 Point

200m 100m 0m 200m 400m

BP RESOURCES CANADA LIMITED

INDUCED POLARIZATION SURVEY

SKOOK PROJECT,OMINECA M.D.;B.C.
BASELINE AZIMUTH : 90 Deg.

SCALE = 1 :10000 DATE:Mar,Apr 1991
SURVEY BY:MJC\MST.P\BC\JJ NTS : 93N/1W,2E
PLAN: SKOOKIP.
Pacific Geophysical Ltd.

680353