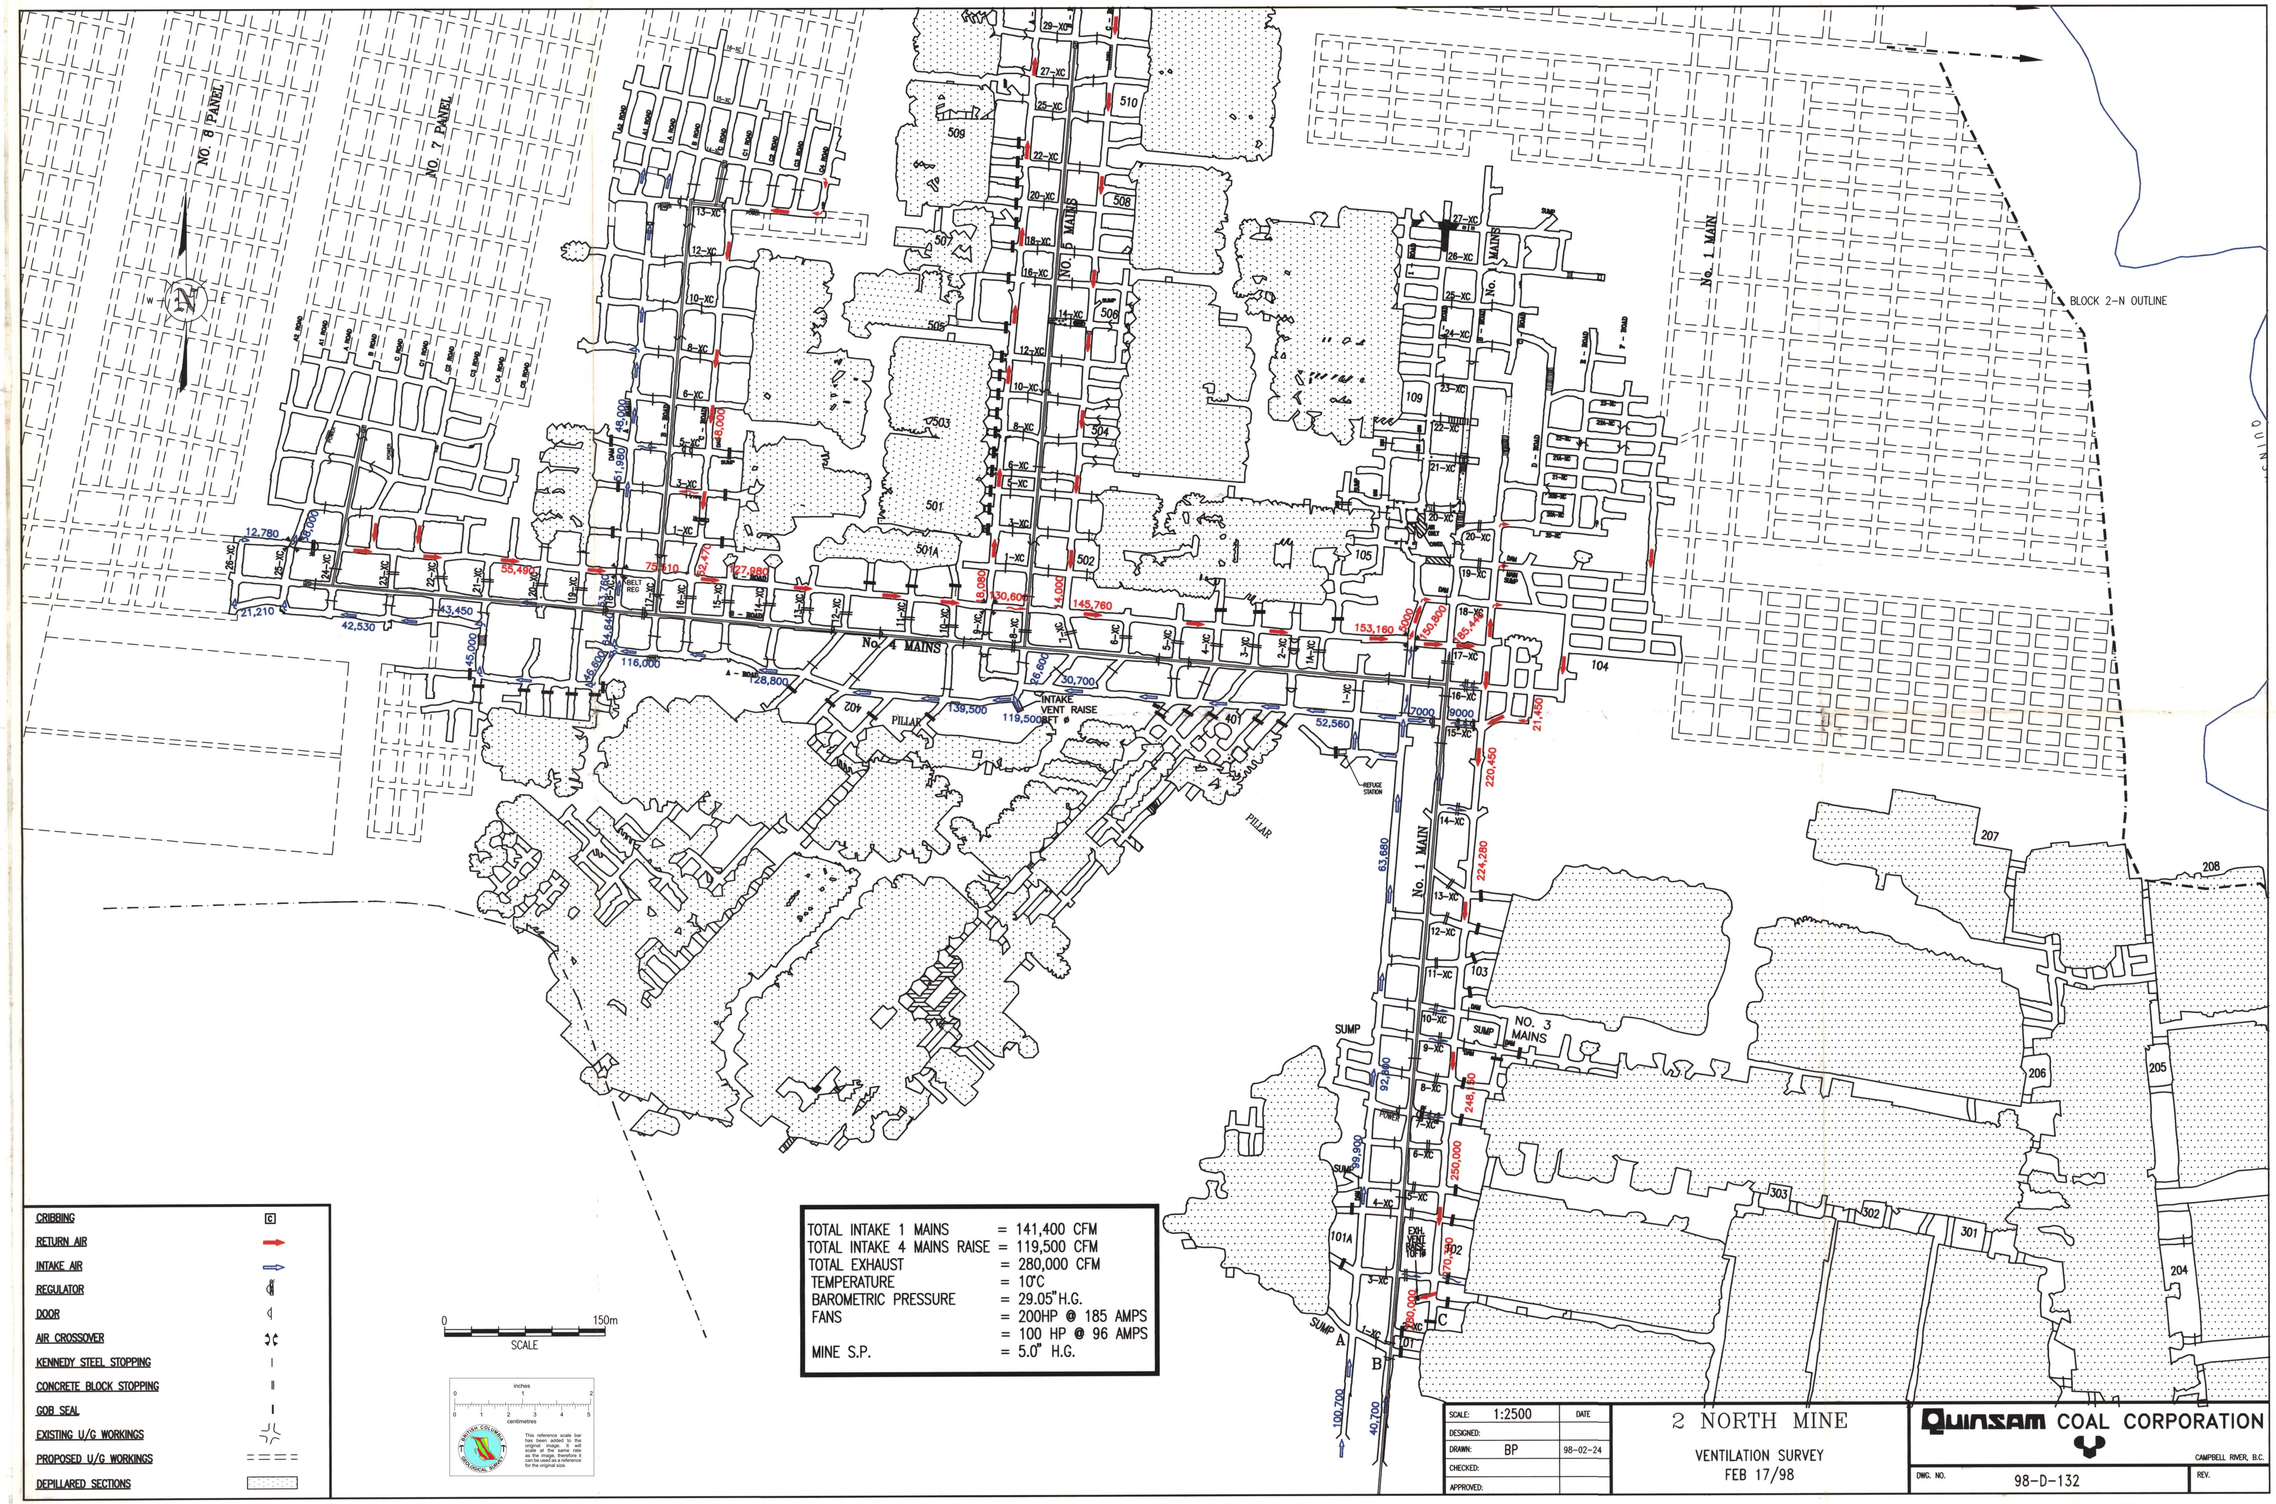
NO. 8 PANEL
NO. 7 PANEL
No. 5 MAINS
No. 4 MAINS
No. 3 MAINS
No. 1 MAIN
BLOCK 2-N OUTLINE
INTAKE VENT RAISE
PILLAR
REFUSE STATION
SUMP
POWER
BELT REG
EXH. VENT RAISE
CRIBBING
RETURN AIR
INTAKE AIR
REGULATOR
DOOR
AIR CROSSOVER
KENNEDY STEEL STOPPING
CONCRETE BLOCK STOPPING
GOB SEAL
EXISTING U/G WORKINGS
PROPOSED U/G WORKINGS
DEPILLARED SECTIONS
0 150m
SCALE
TOTAL INTAKE 1 MAINS = 141,400 CFM
TOTAL INTAKE 4 MAINS RAISE = 119,500 CFM
TOTAL EXHAUST = 280,000 CFM
TEMPERATURE = 10°C
BAROMETRIC PRESSURE = 29.05"H.G.
FANS = 200HP @ 185 AMPS
= 100 HP @ 96 AMPS
MINE S.P. = 5.0" H.G.
SCALE: 1:2500
DATE
DESIGNED:
DRAWN: BP 98-02-24
CHECKED:
APPROVED:
2 NORTH MINE
VENTILATION SURVEY
FEB 17/98
QUINSAM COAL CORPORATION
CAMPBELL RIVER, B.C.
DWG. NO. 98-D-132
REV.

753037