

W. M. SHARP.

801372

OCT 5, 60

TERRACE B.C.


DEAR BILL.

Enclosed herewith is a plotting of remainder of traverse on Hope Silver property. Also HM test results which were carried out (by RHB.) prior to Ag. tests by T.S.L.

Incidentally the porphyritic dyke strikes N35W dip 80° SW at 22N. and runs through 35N 53W. is exposed naturally and somewhat intermittently from 45N TO 20N. at 20N. it strikes into Swamp. is 30 TO 60 ^{ft} wide. at 20N I note a 6 FT. Diorite dyke parallels it. Some ^{minute} shadrs. in diorite are cpy filled.

Yours truly

RH Bates

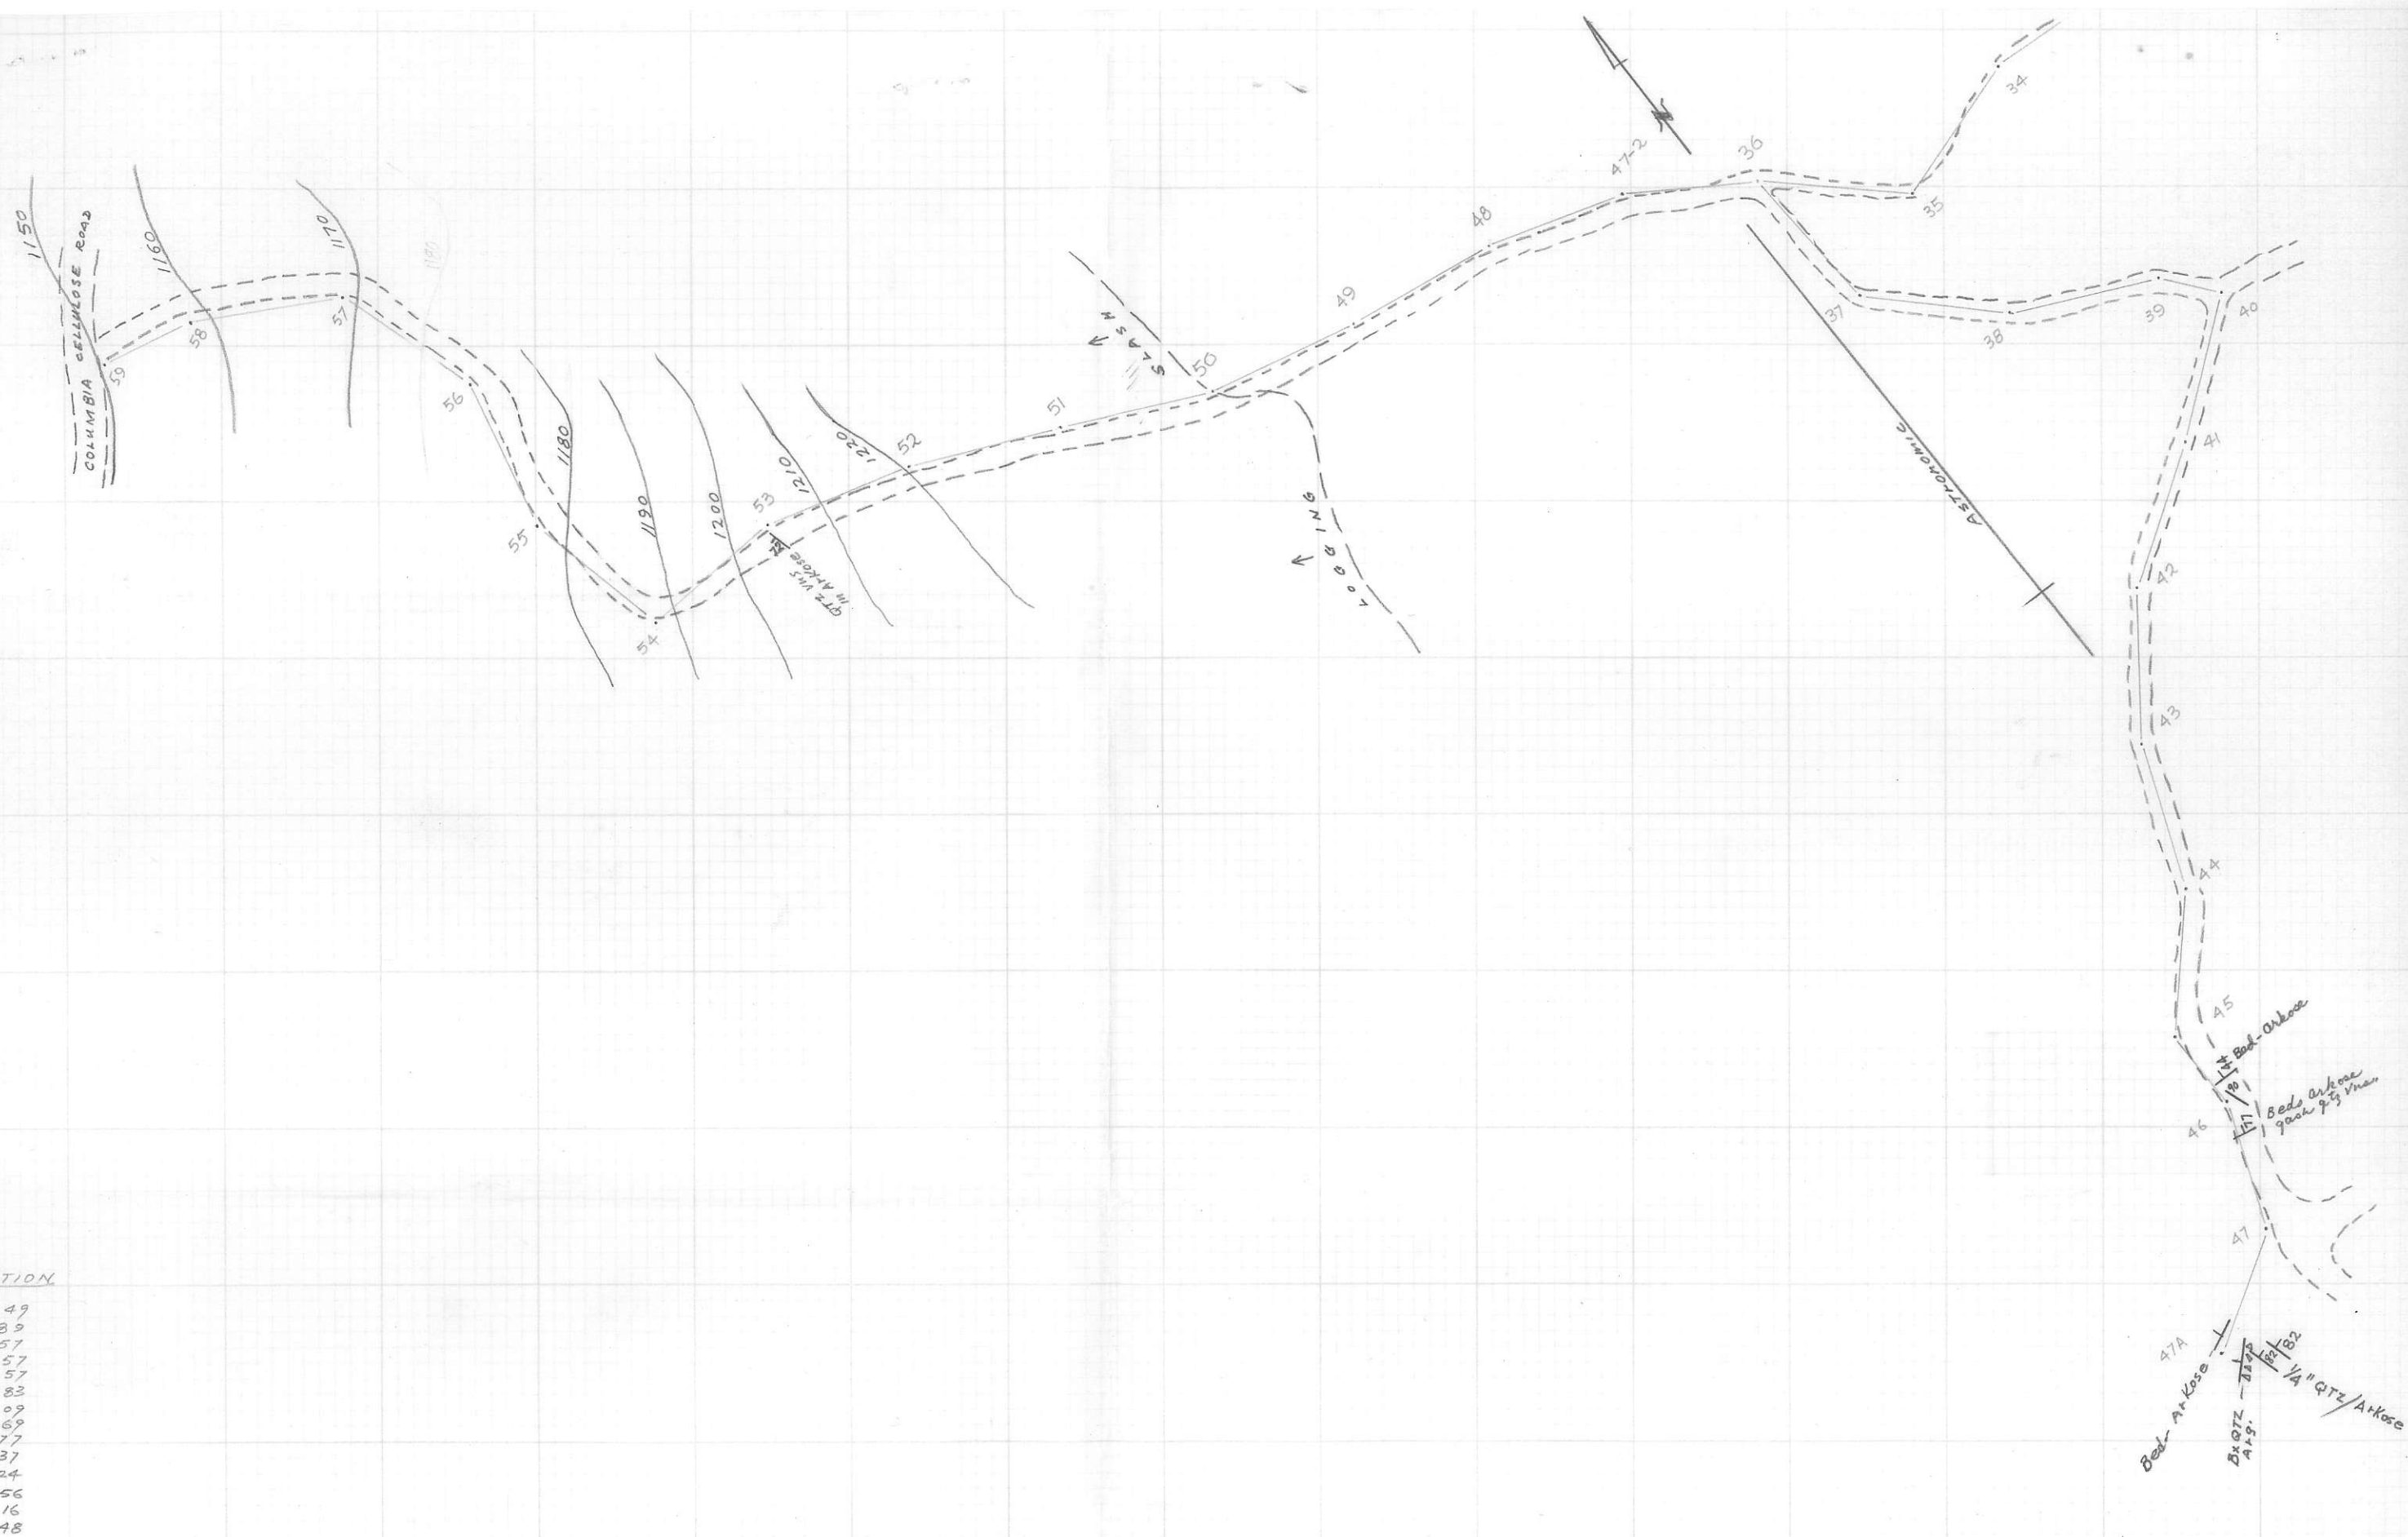

Rec'd Oct. 8. 1929

KLEANZA MINES LTD.
NPL
HOPE SILVER PROPERTY
1 IN = 100 FT R.H.B.