
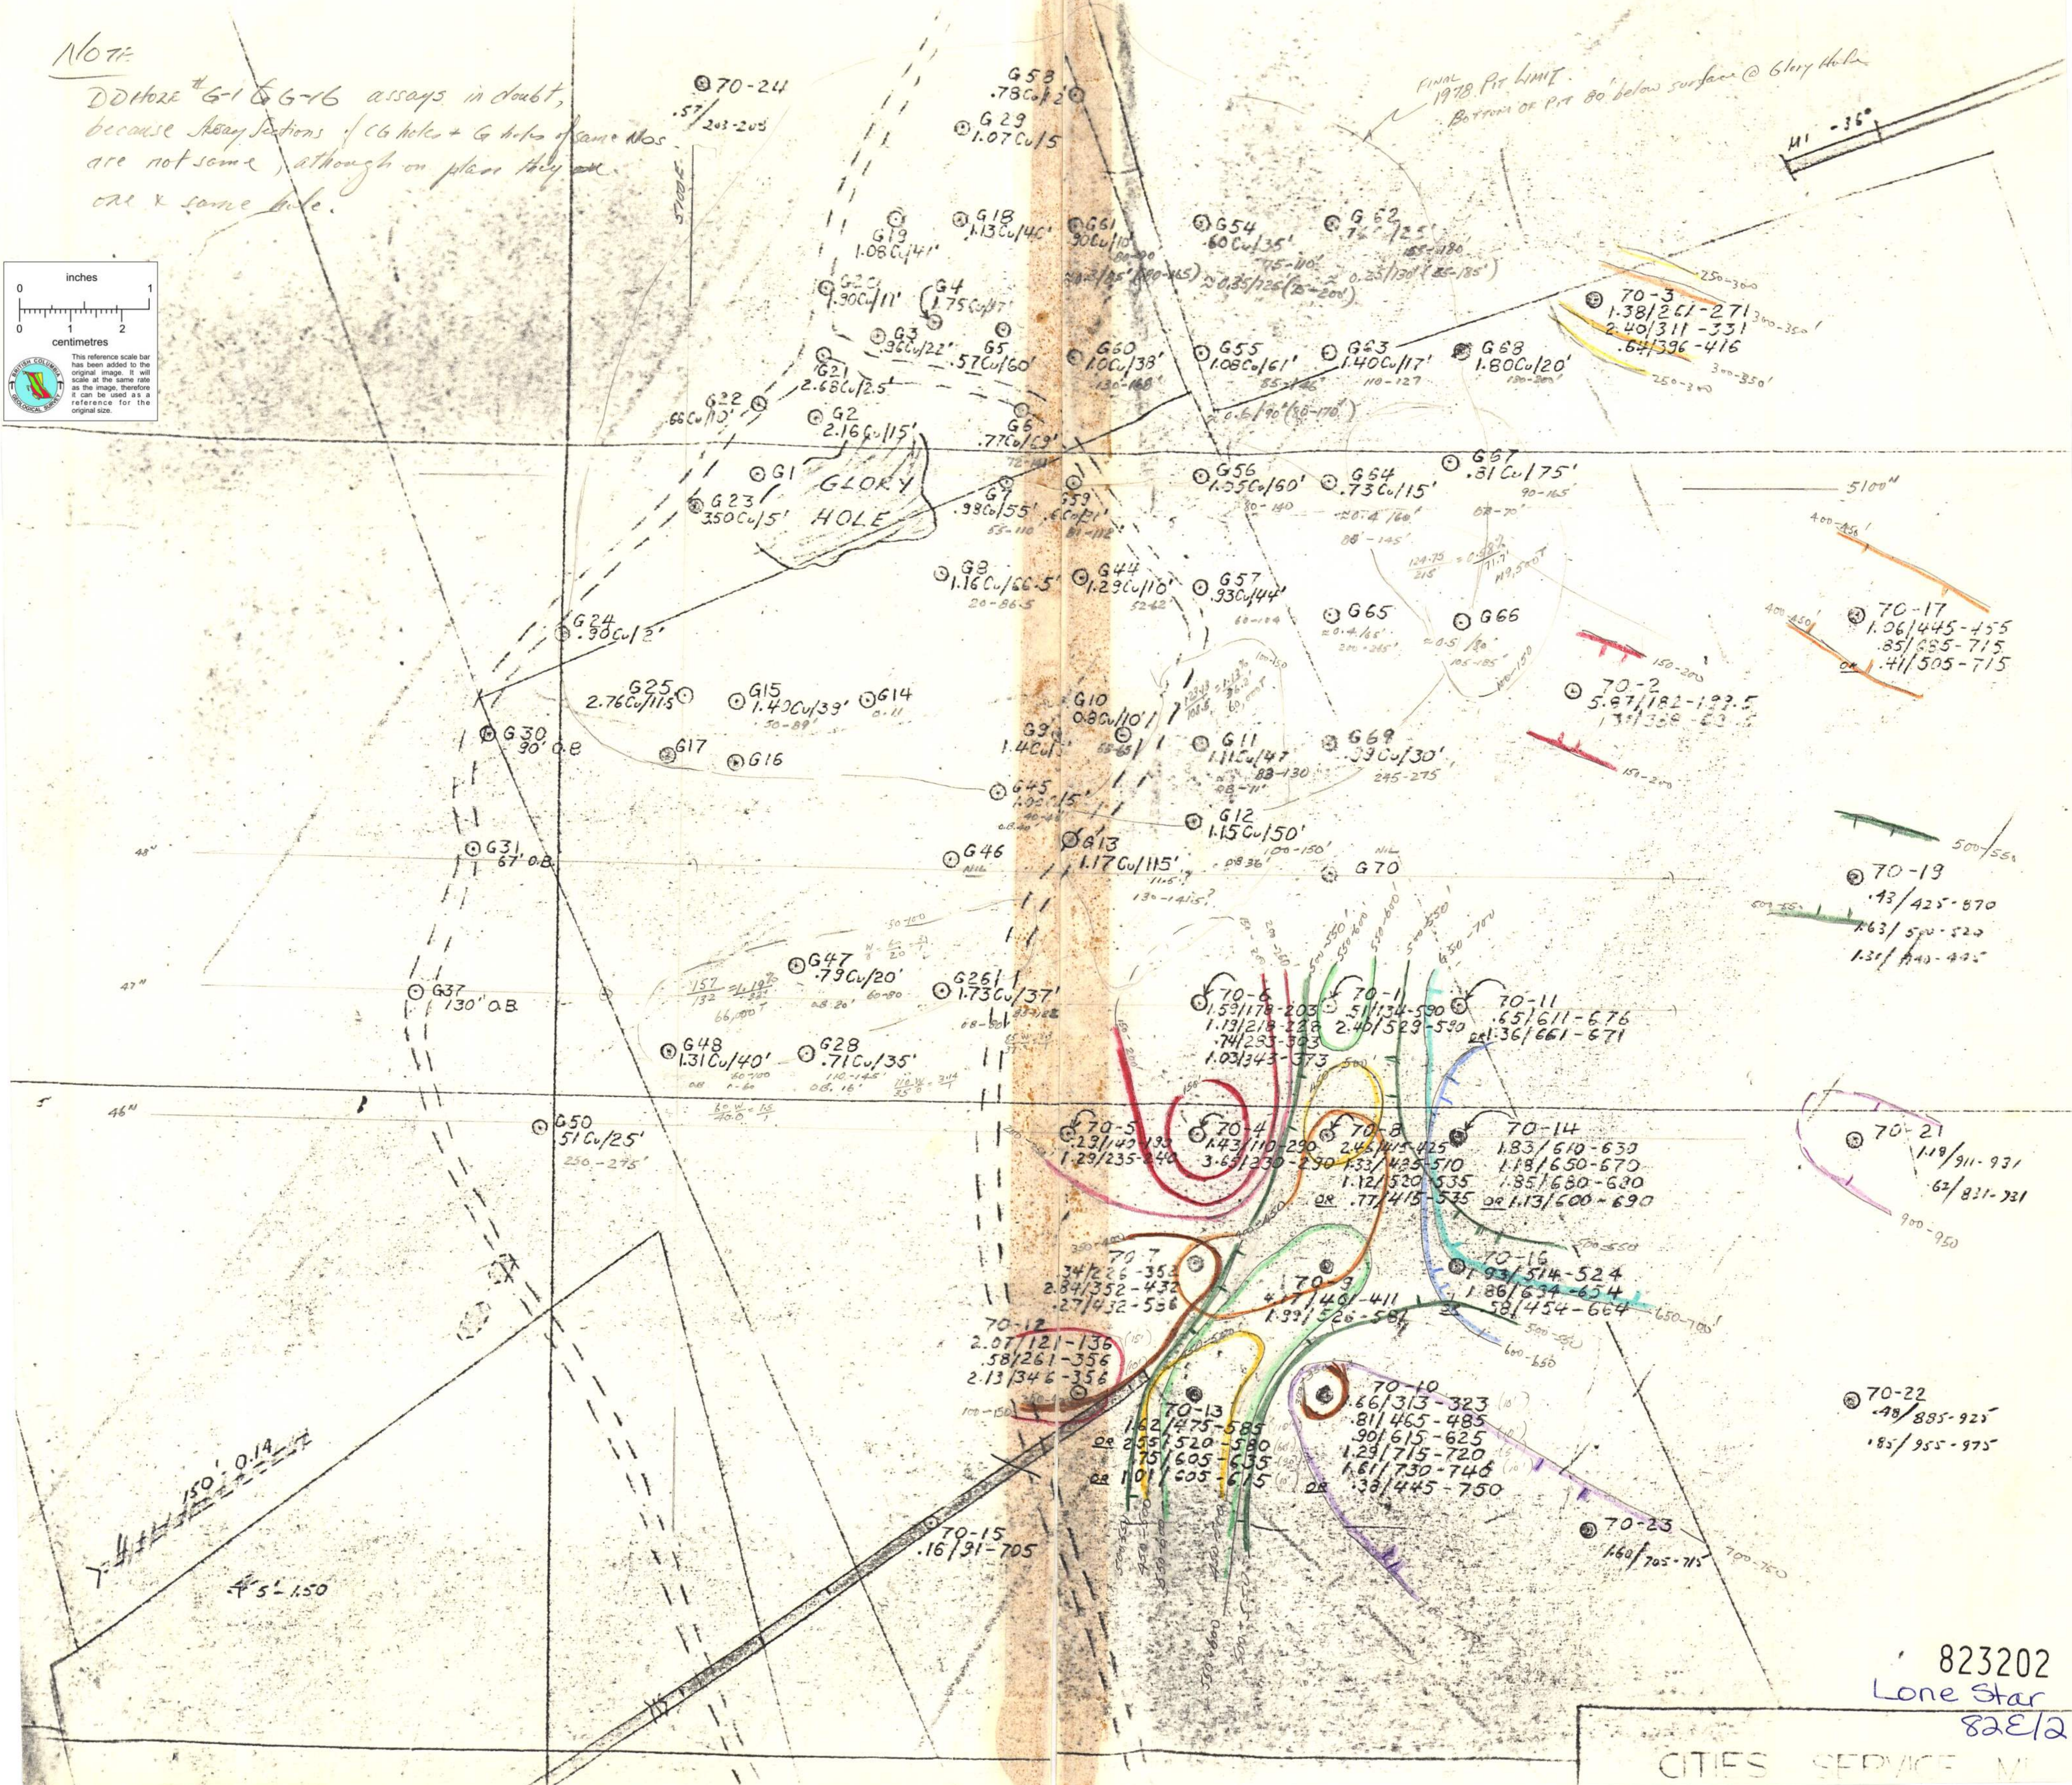


NOTE:

DDHORE #G-1 & G-16 assays in doubt,
because assay sections of G holes + G holes of same Nos.
are not same, although on plan they are
one & same hole.

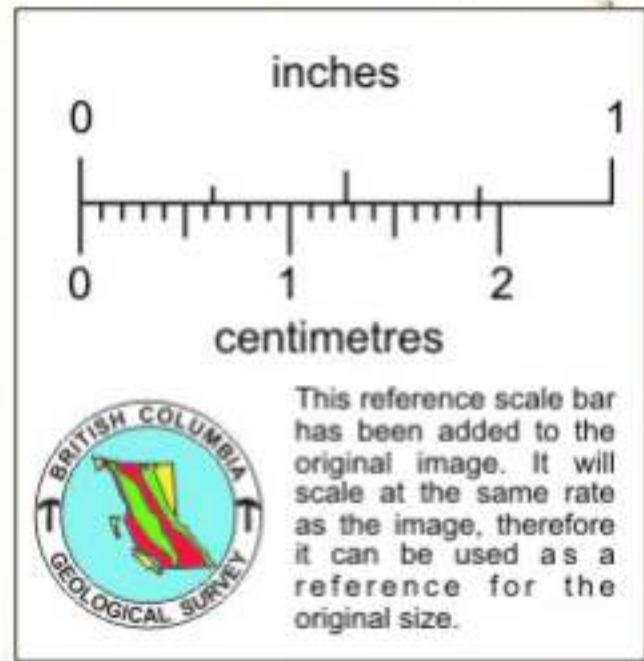

823202
Lone Star
82E/2

CITIES SERVICE M