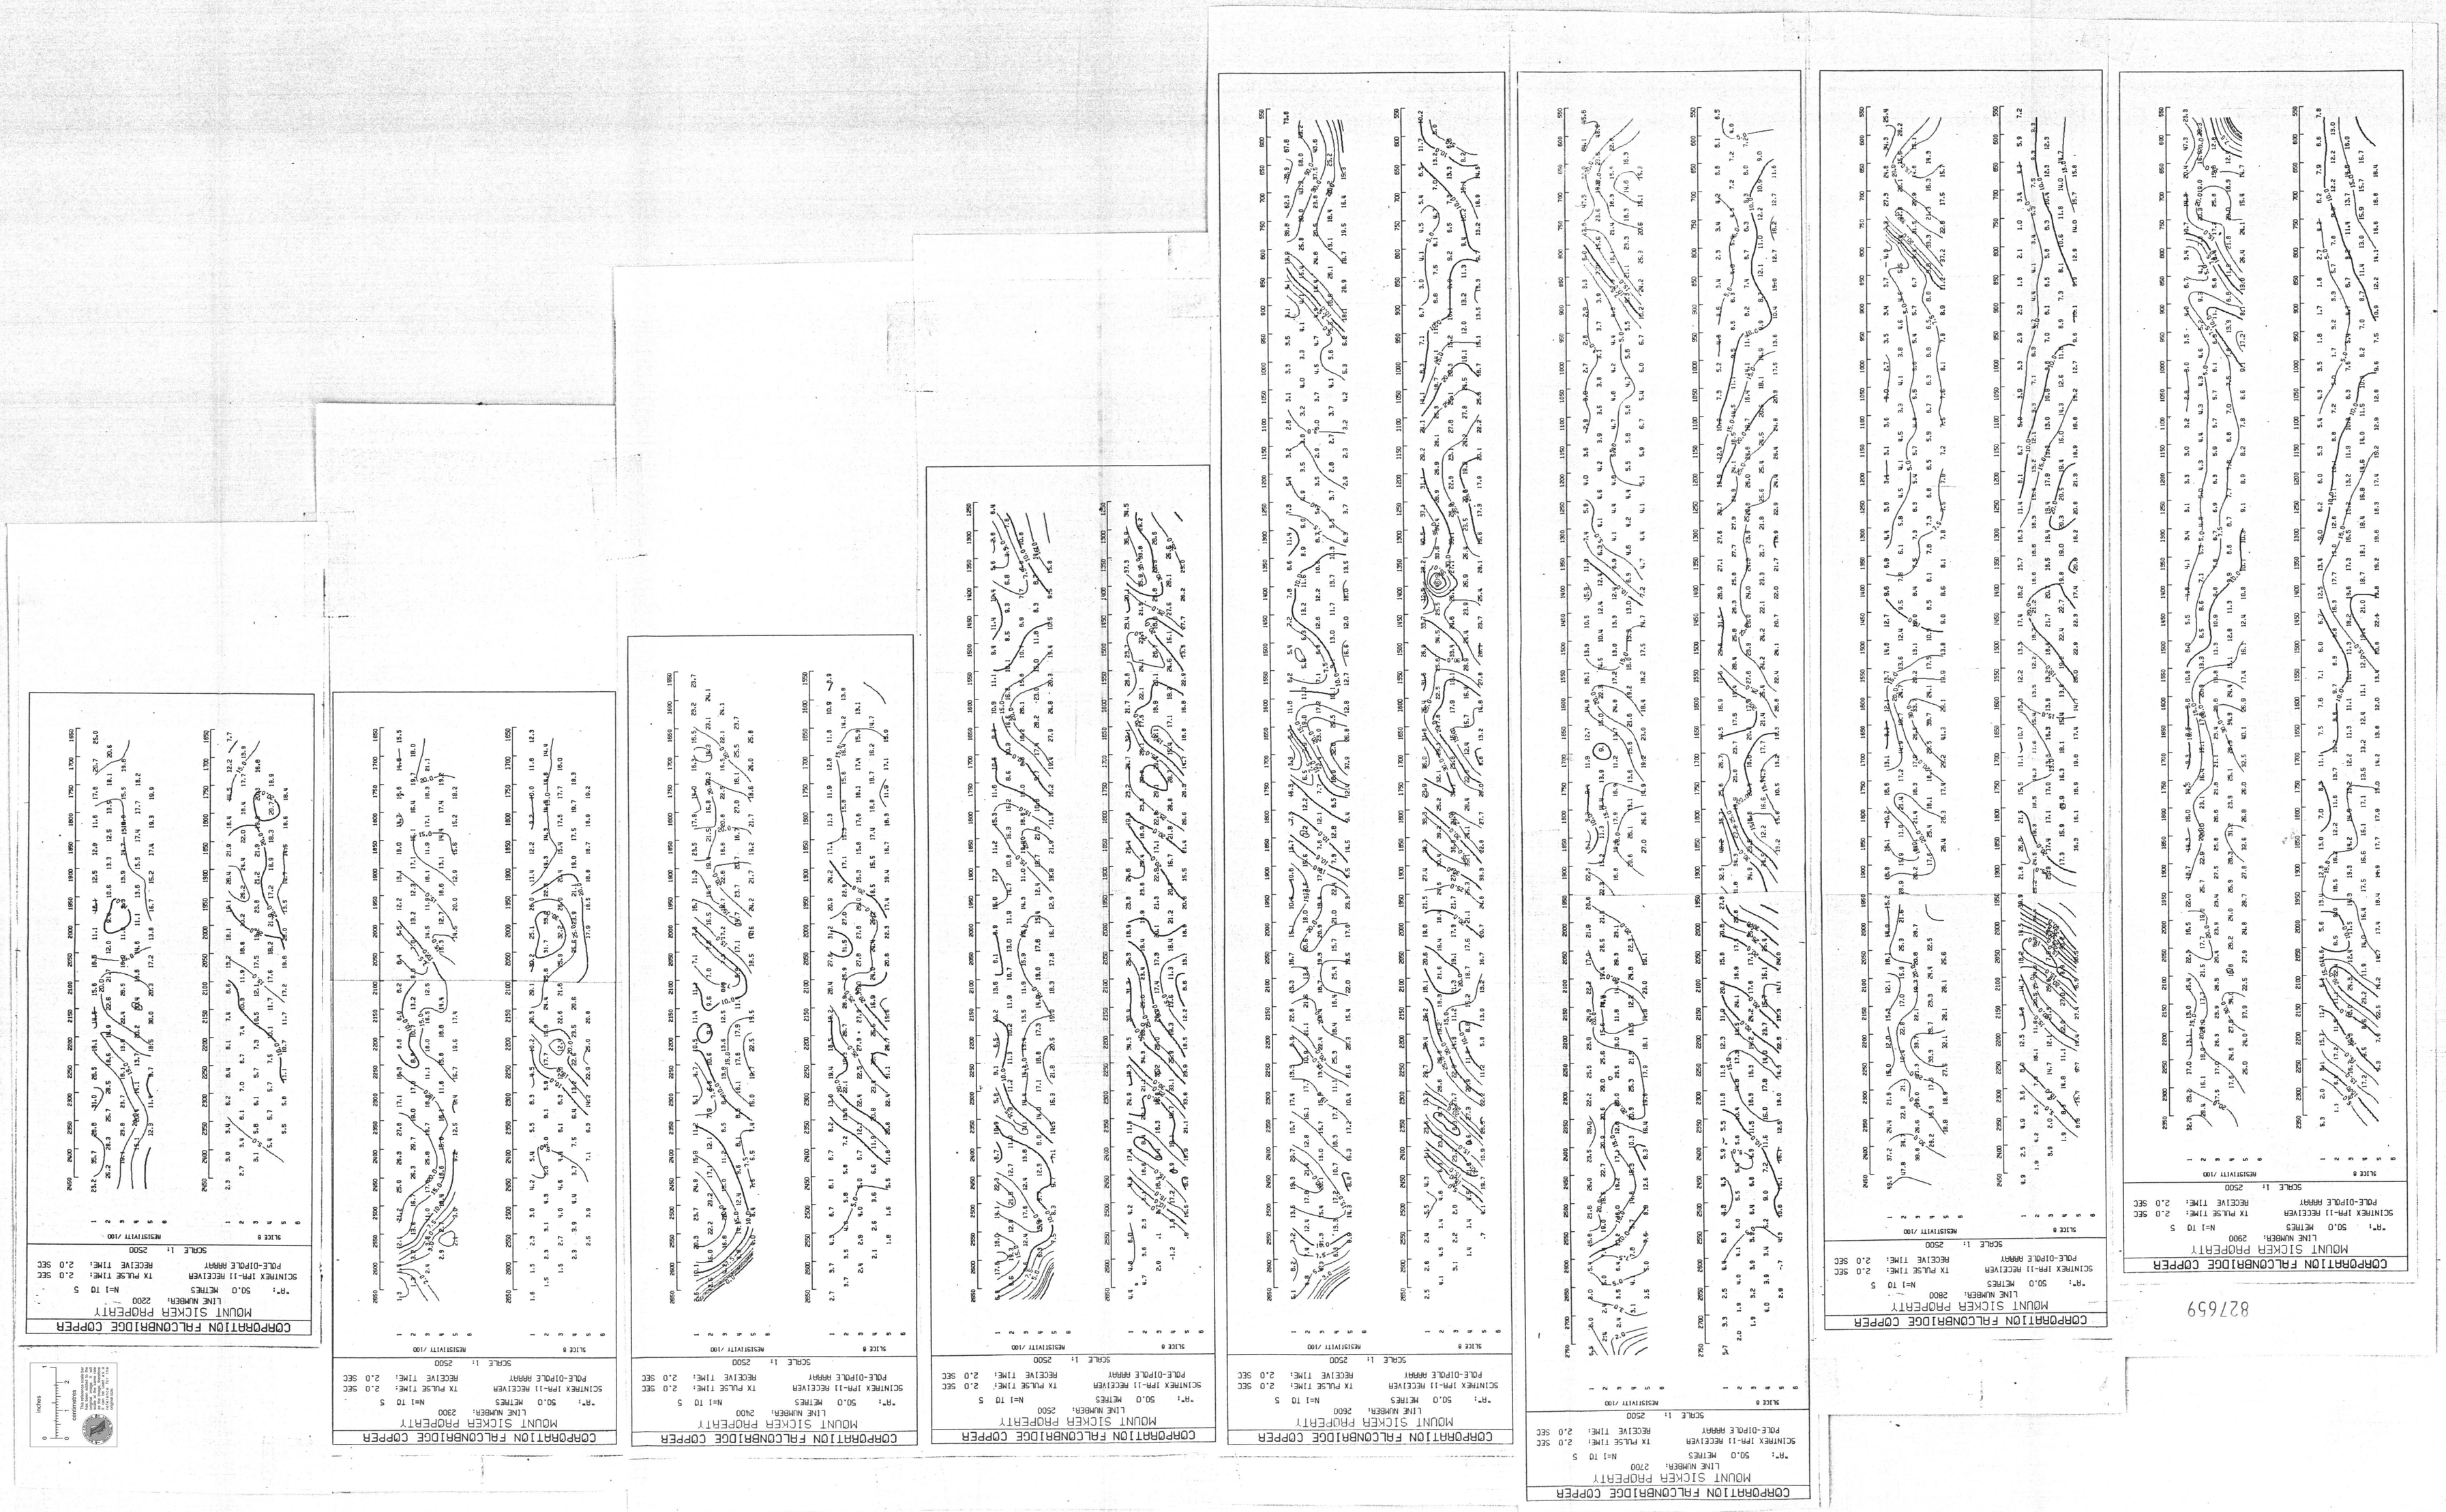
CORPORATION FALCONBRIDGE COPPER
MOUNT SICKER PROPERTY
LINE NUMBER: 2200
"R": 50.0 METRES
N=1 TO 5
SCINTREX IPM-11 RECEIVER
TX PULSE TIME: 2.0 SEC
POLE-DIPOLE ARRAY
RECEIVE TIME: 2.0 SEC
SCALE 1: 2500
RESISTIVITY /100
SLICE 8
CORPORATION FALCONBRIDGE COPPER
MOUNT SICKER PROPERTY
LINE NUMBER: 2300
"R": 50.0 METRES
N=1 TO 5
SCINTREX IPM-11 RECEIVER
TX PULSE TIME: 2.0 SEC
POLE-DIPOLE ARRAY
RECEIVE TIME: 2.0 SEC
SCALE 1: 2500
RESISTIVITY /100
SLICE 8
CORPORATION FALCONBRIDGE COPPER
MOUNT SICKER PROPERTY
LINE NUMBER: 2400
"R": 50.0 METRES
N=1 TO 5
SCINTREX IPM-11 RECEIVER
TX PULSE TIME: 2.0 SEC
POLE-DIPOLE ARRAY
RECEIVE TIME: 2.0 SEC
SCALE 1: 2500
RESISTIVITY /100
SLICE 8
CORPORATION FALCONBRIDGE COPPER
MOUNT SICKER PROPERTY
LINE NUMBER: 2500
"R": 50.0 METRES
N=1 TO 5
SCINTREX IPM-11 RECEIVER
TX PULSE TIME: 2.0 SEC
POLE-DIPOLE ARRAY
RECEIVE TIME: 2.0 SEC
SCALE 1: 2500
RESISTIVITY /100
SLICE 8
CORPORATION FALCONBRIDGE COPPER
MOUNT SICKER PROPERTY
LINE NUMBER: 2600
"R": 50.0 METRES
N=1 TO 5
SCINTREX IPM-11 RECEIVER
TX PULSE TIME: 2.0 SEC
POLE-DIPOLE ARRAY
RECEIVE TIME: 2.0 SEC
SCALE 1: 2500
RESISTIVITY /100
SLICE 8
CORPORATION FALCONBRIDGE COPPER
MOUNT SICKER PROPERTY
LINE NUMBER: 2700
"R": 50.0 METRES
N=1 TO 5
SCINTREX IPM-11 RECEIVER
TX PULSE TIME: 2.0 SEC
POLE-DIPOLE ARRAY
RECEIVE TIME: 2.0 SEC
SCALE 1: 2500
RESISTIVITY /100
SLICE 8
CORPORATION FALCONBRIDGE COPPER
MOUNT SICKER PROPERTY
LINE NUMBER: 2800
"R": 50.0 METRES
N=1 TO 5
SCINTREX IPM-11 RECEIVER
TX PULSE TIME: 2.0 SEC
POLE-DIPOLE ARRAY
RECEIVE TIME: 2.0 SEC
SCALE 1: 2500
RESISTIVITY /100
SLICE 8
CORPORATION FALCONBRIDGE COPPER
MOUNT SICKER PROPERTY
LINE NUMBER: 2900
"R": 50.0 METRES
N=1 TO 5
SCINTREX IPM-11 RECEIVER
TX PULSE TIME: 2.0 SEC
POLE-DIPOLE ARRAY
RECEIVE TIME: 2.0 SEC
SCALE 1: 2500
RESISTIVITY /100
SLICE 8

827659