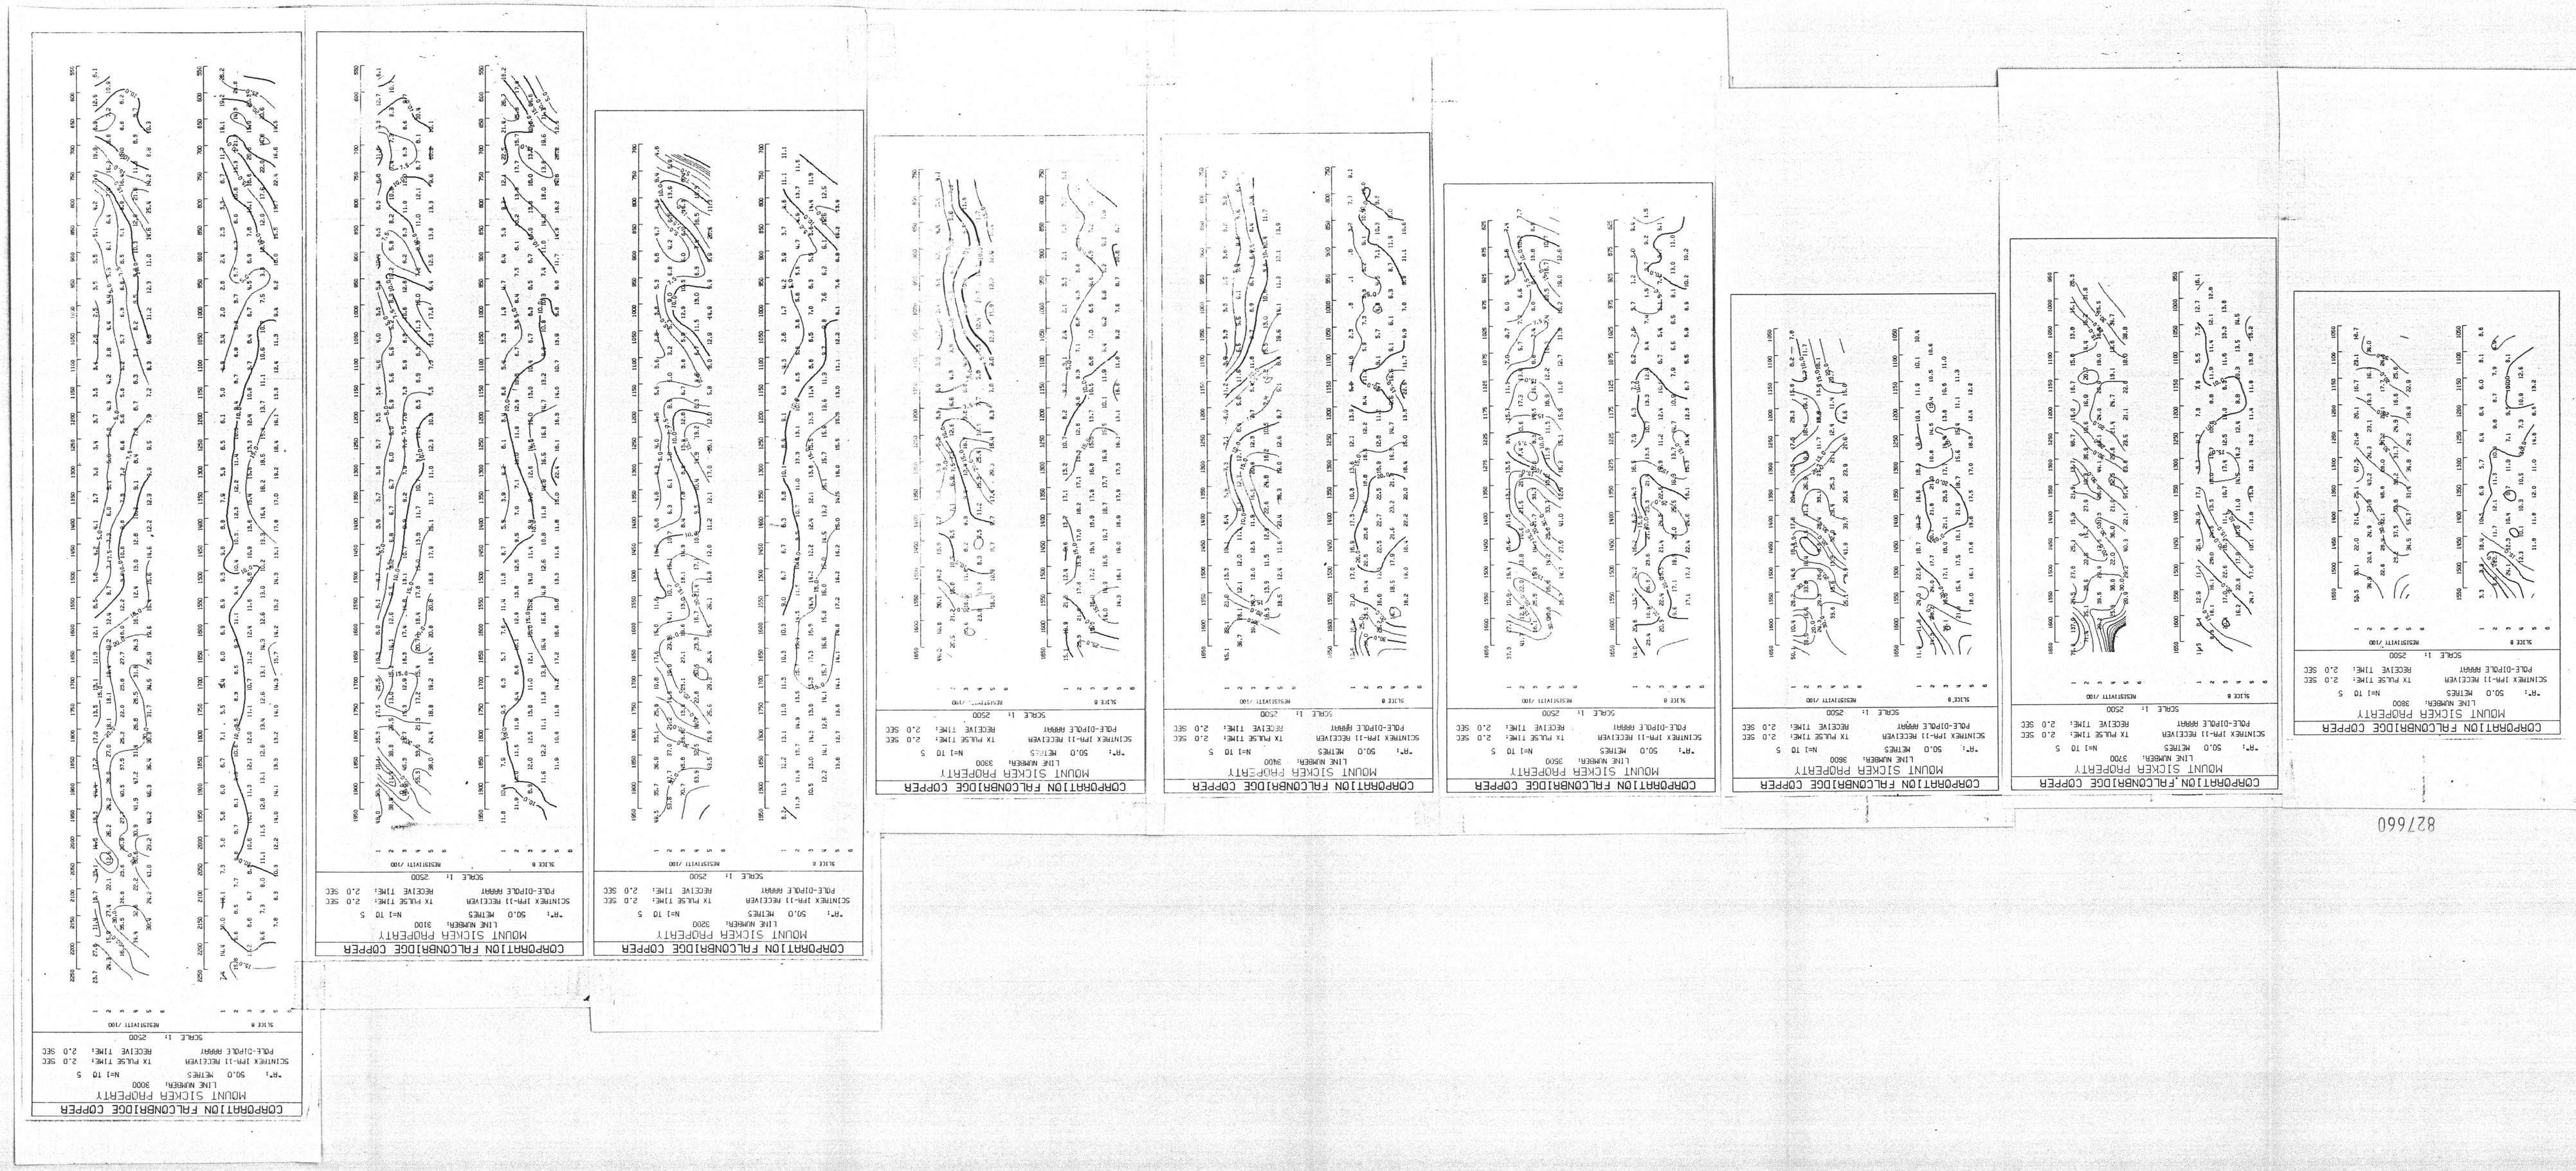
CORPORATION FALCONBRIDGE COPPER
MOUNT SICKER PROPERTY
"R": 50.0 METRES
LINE NUMBER: 3100
SCINTREX IPR-11 RECEIVER
POLE-DIPOLE ARRAY
N=1 10 5
TX PULSE TIME: 2.0 SEC
RECEIVE TIME: 2.0 SEC
SCALE 1: 2500
RESISTIVITY /100
CORPORATION FALCONBRIDGE COPPER
MOUNT SICKER PROPERTY
"R": 50.0 METRES
LINE NUMBER: 3200
SCINTREX IPR-11 RECEIVER
POLE-DIPOLE ARRAY
N=1 10 5
TX PULSE TIME: 2.0 SEC
RECEIVE TIME: 2.0 SEC
SCALE 1: 2500
RESISTIVITY /100
CORPORATION FALCONBRIDGE COPPER
MOUNT SICKER PROPERTY
"R": 50.0 METRES
LINE NUMBER: 3300
SCINTREX IPR-11 RECEIVER
POLE-DIPOLE ARRAY
N=1 10 5
TX PULSE TIME: 2.0 SEC
RECEIVE TIME: 2.0 SEC
SCALE 1: 2500
RESISTIVITY /100
CORPORATION FALCONBRIDGE COPPER
MOUNT SICKER PROPERTY
"R": 50.0 METRES
LINE NUMBER: 3500
SCINTREX IPR-11 RECEIVER
POLE-DIPOLE ARRAY
N=1 10 5
TX PULSE TIME: 2.0 SEC
RECEIVE TIME: 2.0 SEC
SCALE 1: 2500
RESISTIVITY /100
CORPORATION FALCONBRIDGE COPPER
MOUNT SICKER PROPERTY
"R": 50.0 METRES
LINE NUMBER: 3600
SCINTREX IPR-11 RECEIVER
POLE-DIPOLE ARRAY
N=1 10 5
TX PULSE TIME: 2.0 SEC
RECEIVE TIME: 2.0 SEC
SCALE 1: 2500
RESISTIVITY /100
CORPORATION FALCONBRIDGE COPPER
MOUNT SICKER PROPERTY
"R": 50.0 METRES
LINE NUMBER: 3700
SCINTREX IPR-11 RECEIVER
POLE-DIPOLE ARRAY
N=1 10 5
TX PULSE TIME: 2.0 SEC
RECEIVE TIME: 2.0 SEC
SCALE 1: 2500
RESISTIVITY /100
CORPORATION FALCONBRIDGE COPPER
MOUNT SICKER PROPERTY
"R": 50.0 METRES
LINE NUMBER: 3800
SCINTREX IPR-11 RECEIVER
POLE-DIPOLE ARRAY
N=1 10 5
TX PULSE TIME: 2.0 SEC
RECEIVE TIME: 2.0 SEC
SCALE 1: 2500
RESISTIVITY /100
CORPORATION FALCONBRIDGE COPPER
MOUNT SICKER PROPERTY
"R": 50.0 METRES
LINE NUMBER: 3900
SCINTREX IPR-11 RECEIVER
POLE-DIPOLE ARRAY
N=1 10 5
TX PULSE TIME: 2.0 SEC
RECEIVE TIME: 2.0 SEC
SCALE 1: 2500
RESISTIVITY /100

827660