

STIKINE RESOURCES LTD. (SKZ-V,T)								
PRIME RESOURCES GROUP INC (PRU-V)								
SECTION	INTERVAL	LENGTH	GOLD	SILVER	LEAD	ZINC	COPPER	
METRES	FEET	FEET	OZ/T	OZ/TON	%	%	%	
HOLE NO. CA90-645								
12+50N	987.3- 990.6	3.3	1.33	9.70	2.69	2.94	0.20	
	1056.1-1111.9	55.8	0.403	2.07	0.20	0.18	---	
	1220.2-1226.8	6.6	0.098	14.30	na	na	na	
	1282.5-1289.1	6.6	0.130	7.98	na	na	na	
	1334.8-1351.4	6.6	0.176	1.63	na	na	na	
HOLE NO. CA90-646								
12+50N	810.2- 826.6	16.4	0.394	10.53	2.67	4.00	0.43	
incl.	816.7- 820.0	3.3	1.47	21.10	2.80	3.87	0.71	
	826.6- 921.7	95.1	0.365	15.53	5.15	15.27	1.58	
	921.7- 970.9	49.2	0.065	3.90	2.02	3.20	0.35	
	993.8-1003.6	9.8	0.201	9.04	0.07	0.11	---	

na - not assayed

 ASSAYS FROM VISIBLE GOLD REPORTED - Murray Pezim,
 chairman, Prime

Resources Group has reported assay results from two holes on the Eskay Creek project, a 50/50 joint venture with Stikine Resources, located 50 miles northwest of Stewart in NW B.C. The holes No. CA90-645 and CA90-646 are located 100 meters north of all previous drilling and 50 meters south of the Prime/Stikine, 21 Zone discovery and border with the ADRIAN RESOURCES LTD. (ADL-V) property. The holes were collared at 0+50W on section 12+50N. They were designed to test the northward strike extent of the 21B deposit as extrapolated from the 1:500 scale office model that is used to depict the 21 Zone. On June 13, 1990, the company reported a 3.5-foot section in CA90-646 contained numerous small specks of visible gold. The assays showed 3.3 feet assaying 1.47 oz. gold/t, plus 21.1 oz. silver/t. (SEE TABLE ABOVE FOR DETAILED ASSAY RESULTS)


Drill hole CA90-647 encountered similar 21 zone stratigraphy as the above two holes but only contains minor locally disseminated sulphides. Drill hole CA90-648 intersected a mafic dyke at the stratigraphic position that hosts the 21B zone mineralization intersected in hole CA90-645 and CA90-646. Assay results for these latter two holes are pending.

Drill hole CA90-649, which is currently being cored, is planned to test an IP anomaly centred at 1+30W on section 12+50N. Drilling to date on the 21 Zone deposit has shown a direct correlation with IP anomalies and the main body of the 21B zone deposit. Two drill rigs are currently working on the property.

104B 8
p. 1 of 2

George Cross
Revised A

NO. 124(1990)
JUNE 27, 1990

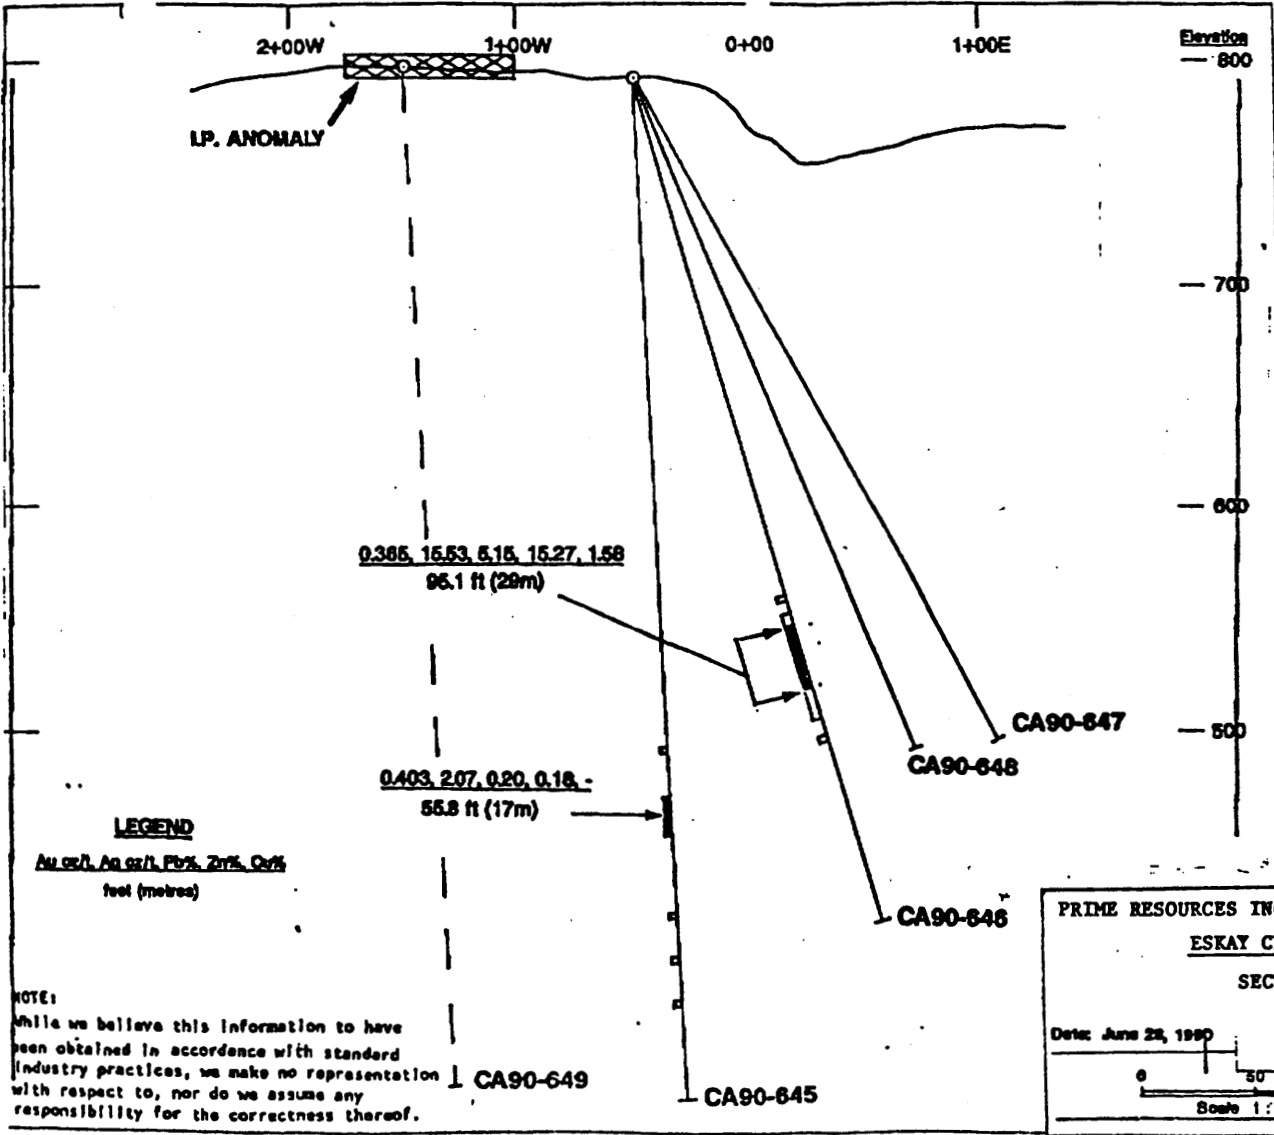

104B 8
P. 2 of 2